

FOR OPERATIONAL GUIDANCE ONLY



Breaking down barriers
and opening doors!

Accessibility Review Tool

Business name _____

Date of review _____

ABILITY
NEW BRUNSWICK



Last updated: **August 2023**

Overview

Ability New Brunswick has developed the following review/assessment tool to promote good design including universal design. The National Building Code and New Brunswick Building Code, including the Barrier-Free Design Building Code regulation, provide only a minimum standard for accessibility. With a high rate of disability in New Brunswick, high unemployment rates among persons with a disability, an aging population and the opportunity to access an untapped labour market pool and benefit from accessible tourism, there is a need to exceed minimum standards for accessibility. This assessment tool recognizes areas of excellence in accessibility and also draws attention to several areas where accessibility can be improved by good design.

This assessment tool reviews employer work sites and provides specific recommendations for new design, modifications and adaptations that would enable more businesses to hire persons with a disability and attract a new customer base. Recommendations will reflect best practice standards in universal and barrier-free design, accessibility legislation, regulations and relevant human rights. The review tool will also include funding sources and be linked to agencies that assist with the hiring and recruitment of persons with a disability.

A PDF of the confidential review with a detailed list of recommendations will be provided to the business owner/operator upon completion of the review. Business owners/operators will be asked to complete a short survey before the review and following receipt of the final review and recommendations.

Participant information

Please print clearly (or type).

Name of business / facility	
Name of business / facility owner / operator	
Mailing address (including postal code)	
Street address (if different from above)	
Telephone number	
E-mail	
Name of reviewer(s)	
Review completion date	
Signature of review	

FOR OPERATIONAL GUIDANCE ONLY

Executive Summary

This is a high-level overview to prioritize recommendations but should not be considered the only recommendations that must be implemented to make your site a fully accessible and inclusive space.

Site summary (A brief description of this site and its key spaces and features)

Key priorities (Overview of the primary barriers and priorities to address)

Quick fixes (Overview of items that are low cost and easy to implement quickly)

FOR OPERATIONAL GUIDANCE ONLY

INTERIOR SPACES

1.0 ENTRANCES		YES	NO	N/A	MEASUREMENTS
1.	<p>Are 50% of the pedestrian entrances of the building accessible and:</p> <p>a. lead from the outdoors at sidewalk level or a ramp that leads from a sidewalk? (NB 3.8.2.2.1)</p> <p>b. are easy to locate from the main route with a clearly visible street address/building name or wayfinding signage? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p>
2.	Does the signage at the door comply with Section 8.0 of the Accessibility Tool?				
3.	Is the <i>International Symbol of Access</i> in place to identify the location of an accessible entrance (e.g. on a power door button or sticker on the door)? (NB 3.8.3.6.6(ii))				
4.	<p>Is the entrance:</p> <p>a. at least 86cm wide, excluding any hardware, when in the open wide position? (CSA B651-23, 5.2.1)</p> <p>b. well-illuminated? (COP – Lighting)</p> <p>c. colour contrasted from the surrounding walls or surfaces?(COP – Building Entrances)</p> <p>d. identifiable with tactile indicators, such as cane detectors or surface changes? (COP – Building Entrances)</p> <p>e. sheltered? (GCAF – Sidewalks, Pathways and Trails)</p> <p>f. cleared of snow and ice and well-salted or well-sanded in the winter? (GCAF – Sidewalks, Pathways and Trails)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>

1.0 ENTRANCES		YES	NO	N/A	MEASUREMENTS
5.	<p>If the entrance door has a fully glazed panel:</p> <p>a. is the panel transparent? (CSA B651-23, 5.2.10(a))</p> <p>b. does it have its lower edge no higher than 90cm from the floor or ground? (CSA B651-23, 5.2.10(b))</p> <p>c. is it marked with a continuous opaque strip that is:</p> <ul style="list-style-type: none"> • colour contrasted with the door? (CSA B651-23, 5.2.10(c)(ii)) • at least 5cm high? (CSA B651-23, 5.2.10(c)(iii)) • extends the full width of the door? (CSA B651-23, 5.2.10(c)(iv)) • located between 135cm to 150cm from the floor or ground?(CSA B651-23, 5.2.10(c)(iv)) 				<p>a.</p> <p>b.</p> <p>c.</p> <p>•</p> <p>•</p> <p>•</p> <p>•</p>
6.	<p>Is the door threshold no more than 1.3cm high? (NB 3.8.3.6.5)</p>				
7.	<p>Does the accessible entrance door open with low pressure using:</p> <p>a. a functioning power door? (NB 3.8.3.6.6)</p> <p>b. a functioning automatic sliding door? (NB 3.8.3.6.6(a))</p> <p>c. lever handles at a height of 90cm to 110cm from the floor or ground? (NB 3.8.3.6.4(b))</p> <p>d. push plates or pull handles at a height 90cm to 110cm from the floor or ground? (NB 3.8.3.4(b))</p> <p>e. no door at all?</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>

1.0 ENTRANCES	YES	NO	N/A	MEASUREMENTS
<p>8. For power doors, do they:</p> <p>a. have operable controls for hand activation located between 90cm and 110cm above the floor or ground? (NB 3.8.3.6.6(a)(v))</p> <p>b. have operable controls for foot activation located 15cm to 30cm above the floor or ground? (NB 3.8.3.6.6(a)(v))</p> <p>c. have controls that are located clear of the door swing and no more than 150cm from the door swing? (CSA B651-23, 5.2.9.2(c))</p> <p>d. have controls marked with the <i>International Symbol of Access</i>? (CSA B651-23, 5.2.9.3(d)(iii))</p> <p>e. fully open in not less than 3 seconds? (NB 3.8.3.6.6 (b)(i))</p> <p>f. require a force of no more than 65 Newtons to stop the movement of the door? (NB 3.8.3.6.6 (b)(ii))</p> <p>g. have a cane detectable guard on the hinged side of the door if it swings into the path of travel? (NB 3.8.3.6.6 (7))</p>				a. b. c. d. e. f. g.
<p>9. From the pull side of the door, is there at least 150cm by 170cm clear, level floor area? (CSA B651-23, 5.2.2, Table 8)</p>				
<p>10. From the push side of the door, is there at least 150cm by 120cm clear, level floor area? (CSA B651-23, 5.2.2, Table 8)</p>				

1.0 ENTRANCES	YES	NO	N/A	MEASUREMENTS
<p>11. For a front approach to a swinging door:</p> <p>a. is there at least 30cm of clear space from the latch on the push side of the door? (CSA B651-23, 5.2.2, Figure 20a)</p> <p>b. is there at least 60cm of clear space from the latch on the pull side of the door? (CSA B651-23, 5.2.2, Figure 20a)</p>				<p>a.</p> <p>b.</p>
<p>12. For a latch edge side approach to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20b)</p>				
<p>13. For a hinged side approach to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20c)</p>				
<p>14. If there is a vestibule:</p> <p>a. is there at least 120cm width? (CSA B651-23, 5.2.5, Figure 21a)</p> <p>b. is there a width between doors of at least 139cm in addition to the width of any door swinging into the space? (CSA B651-23, 5.2.5 Figure 21a; 21b)</p>				<p>a.</p> <p>b.</p>
<p>15. Does the pushing or pulling force of the door not exceed 38 Newtons for exterior swinging doors? (CSA B651-23, 5.2.8(a))</p>				

1.0 ENTRANCES	YES	NO	N/A	MEASUREMENTS
<p>16. If there is a card reader:</p> <p>a. is the entry slot located between 80cm to 90cm from the floor or ground? (CSA B651-23, 5.7.4.2.1(a)(i))</p> <p>b. is it colour contrasted from the wall or door? (CSA B651-23, 5.7.4.2.1(a)(iii))</p> <p>c. does it include tactile graphics on the surface to identify direction of card insertion? (CSA B651-23, 5.7.4.2.1(b)(ii))</p> <p>d. does it have audible signals to indicate opening? (CSA B651-23, 5.7.4.2.1(c))</p> <p>e. does it have visual signals to indicate opening? (CSA B651-23, 5.7.4.2.1(c))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
<p>17. If there is a proximity reader:</p> <p>a. is it located between 80cm to 120cm from the floor or ground?(CSA B651-23, 5.7.4.2.2(a))</p> <p>b. does it have audible signals to indicate opening? (CSA B651-23, 5.7.4.2.2(b))</p> <p>c. does it have visual signals to indicate opening? (CSA B651-23, 5.7.4.2.2(b))</p>				<p>a.</p> <p>b.</p> <p>c.</p>
<p>18. If there is a keypad:</p> <p>a. is it located between 80cm to 120cm from the floor or ground?(CSA B651-23, 5.7.4.3(a))</p> <p>b. is it colour contrasted from the wall or door? (CSA B651-23, 5.7.4.3(b))</p> <p>c. does it have colour contrasted characters or numbers from the keys? (CSA B651-23, 5.7.4.3(c))</p> <p>d. if numeric, are there tactile graphics on the keys? (CSA B651-23, 5.7.4.3(d))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>

1.0 ENTRANCES		YES	NO	N/A	MEASUREMENTS
19.	<p>If there are mats, runners or carpets at the entrance:</p> <p>a. are they slip-resistant and secure? (CSA B651-23, 4.4.3(c))</p> <p>b. do they have a thickness not more than 1.3cm?(CSA B651-23, 4.4.3(b))</p>				<p>a.</p> <p>b.</p>
20.	Is there a visible directory for the building (e.g. suite room list, mall map) that complies with Section 8.0 of the Accessibility Tool ?				

2.0 INTERIOR RAMPS		YES	NO	N/A	MEASUREMENTS
1.	Does the ramp have a slip-resistant surface, even when wet? (NB 3.8.3.5(4))				
2.	If the ramp surface is constructed of steel grating, are the openings no more than 1.3cm wide? (CSA B651-23, 4.4.4(a))				
3.	Does the ramp have: <ul style="list-style-type: none"> a. a running slope of no more than 1:12 (8.3%)? (NB 3.8.3.5(1)(b)) b. a cross slope of no more than 1:50 (2%)? (NB 3.8.3.5(4)(b)) c. a maximum length of 900cm in total or between intervals? (NB 3.8.3.5(1)(d)(i)) 				a. b. c.
4.	Is there an unobstructed, firm and level area of 170cm by 170cm : <ul style="list-style-type: none"> a. at the top of the ramp? (CSA B651-23, 5.5.4(a)) b. at ramp intervals? (CSA B651-23, 5.5.4(b)) c. at the bottom of the ramp?(CSA B651-23, 5.5.4(a)) 				a. b. c.
5.	At the top landing, is there: <ul style="list-style-type: none"> a. at least 60cm beyond the edge of the door opening when the door opens towards the ramp? (NB 3.8.3.5 1(c)(i)(ii)) b. at least 30cm beyond the edge of the door where the door opens away from the ramp? (NB 3.8.3.5 1(c)(i)(ii)) 				a. b.

2.0 INTERIOR RAMPS	YES	NO	N/A	MEASUREMENTS
<p>6. Are the handrails:</p> <p>a. on both sides of the ramp and continuous around landings? (CSA B651-23, 5.5.8(a)(iii))</p> <p>b. colour contrasted to the surroundings? (CSA B651-23, 5.5.8(a)(iv))</p> <p>c. 92cm to 100cm wide between rails? (CSA B651-23, 5.5.8(b))</p> <p>d. at a height of 86cm to 92cm from the ramp surface to the top of the rail? (CSA B651-23, 5.5.8(a)(ii))</p> <p>e. extended horizontally at least 30cm beyond the top and bottom of the ramp and curved towards the post, floor or wall? (CSA B651-23, 5.5.8(c))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
<p>7. If the ramp is wider than 150cm, is there an intermediate rail located in the middle within 75cm of one of the handrails? (NBC 3.8.3.5.1(e))</p>				
<p>8. Where the ramp or landing is not at grade or not adjacent to a wall, is there one of the following:</p> <p>a. edge protection on both sides of at least 10cm high? (CSA B651-23, 5.5.7(a))</p> <p>b. a railing with its lower edge not more than 10cm from the surface? (CSA B651-23, 5.5.7(b))</p>				<p>a.</p> <p>b.</p>

2.0 INTERIOR RAMPS		YES	NO	N/A	MEASUREMENTS
9.	Is there a threshold of no more than 1.3cm : a. at the top of the ramp? (NB 3.8.3.6.2(2)) b. at any interval? (NB 3.8.3.6.2(2)) c. at the bottom of the ramp? (NB 3.8.3.6.2(2))				a. b. c.
10.	Does the ramp have tactile attention walking surface indicators at the beginning and end of the ramp? (COP - Attention TWSI)				
11.	Is the ramp well-illuminated, at a minimum of 200 lux , to avoid shadows or glare? (COP - Lighting)				

3.0 ELEVATORS		YES	NO	N/A	MEASUREMENTS
1.	Does the business offer services on multiple floors? If "yes", proceed to next question. If "no", proceed to next section.				
2.	If the facility has a lift elevator, can it be operated without a key?				
3.	Is there an emergency/evacuation plan in place (e.g. evacuation chairs, area of refuge) that complies with Section 9.0 of the Accessibility Tool ?				
4.	Is the location of the elevator clearly marked with wayfinding signage that complies with Section 8.0 of the Accessibility Tool ? (COP - Signage); (NB 3.8.2.10.1)				
5.	Are hall buttons outside of the elevator: <ul style="list-style-type: none"> a. located between 89cm and 122cm above the floor? (CSA B44:19, E-15) b. located where there is clear, unobstructed floor space of at least 76cm wide and 122cm long? (CSA B44:19, E-15) c. at least 1.9cm wide? (CSA B44:19, E-15) d. equipped with visual indicators? (CSA B44:19, E-15) e. equipped with audible indicators? (CSA B44:19, E-15) 				a. b. c. d. e.
6.	Does the elevator door have a clear width of at least 106.5cm when open? (CSA B44:19, Table E-5-1)				
7.	Do the elevator doors remain open for a minimum of 5 seconds ? (COP - Elevator Cabs)				

3.0 ELEVATORS		YES	NO	N/A	MEASUREMENTS
8.	Does the elevator stop level to floor landings with a threshold of no more than 1.3cm ? (CSA B44:19, E-3)				
9.	Does the elevator have a yellow strip of at least 5cm deep across the threshold to create contrast and enhance the visibility of the entrance? (COP - Elevator Cabs)				
10.	Are all cab control buttons: <ul style="list-style-type: none"> a. operable with one hand? (CSA B44:19, E-9) b. located a maximum of 122cm from the floor? (CSA B44:19, E-9) c. equipped with raised characters and braille? (CSA B44:19, E-9) d. illuminated when pressed? (CSA B44:19, E-9) 				<ul style="list-style-type: none"> a. b. c. d.
11.	Does the elevator have: <ul style="list-style-type: none"> a. tactile signage that complies with Section 8.0 of the Accessibility Tool? b. audible indicators (e.g. door closing and opening, floor numbers)? (CSA B44:19, E-10.3) c. emergency features that comply with Section 9.0 of the Accessibility Tool? 				<ul style="list-style-type: none"> a. b. c.
12.	Does the interior of the elevator have a clear floor space of at least 137cm by 203cm ? (CSA B44:P19, E-8)				
13.	Does the exterior of the elevator have a clear floor space of at least 150cm by 150cm ? (NB 3.8.3.6.14(b))				

3.0 ELEVATORS	YES	NO	N/A	MEASUREMENTS
14. Is the perimeter of the elevator indicated with tactile walking surface indicators or tactile attention surface indicators? (COP - Tactile Walking Surface Indicators)				
15. Is the floor surface of the interior of the elevator firm, stable and slip-resistant? (CSA B44:19, E-12)				
16. Does the interior of the elevator have colour contrast between the floor (lighter colour or with a light perimeter indicator) and the walls? (COP, Elevator Cabs)				
17. Does the interior of the elevator have handrails that: a. are on all non-access (door) walls? (CSA B44:19, E-13) b. are located at a height of 80cm to 92cm from the floor? (CSA B44:19, E-13) c. have a space of 3.5cm to 4.5cm between the handrail and the wall? (CSA B44:19, E-13)				a. b. c.
18. Are mirrors inside the elevator positioned to avoid glare? (COP - Elevator Cabs)				
19. Is the elevator well-illuminated at a minimum of 200 lux ? (COP - Elevator Cabs)				
20. Is the lighting positioned in a way to minimize glare? (COP - Placement of Light Fixtures)				

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
1.	Do interior doors open with low pressure using: <ul style="list-style-type: none"> a. a functioning power door? (NB 3.8.3.6.6) b. a functioning automatic sliding door? (NB 3.8.3.6.6(a)) c. lever handles at a height of 90cm to 110cm from the floor? (NB 3.8.3.6.4(b)) d. push plates or pull handles at a height 90cm to 110cm from the floor? (NB 3.8.3.4(b)) e. no door at all? 				a. b. c. d. e.
2.	For power doors, do they: <ul style="list-style-type: none"> a. have operable controls for hand activation located between 90cm and 110cm above floor level? (NB 3.8.3.6.6(a)(v)) b. have operable controls for foot activation located 15cm to 30cm above the floor? (NB 3.8.3.6.6(a)(v)) c. have controls that are located clear of the door swing and no more than 150cm from the door swing? (CSA B651-23, 5.2.9.2(c)) d. have controls marked with the <i>International Symbol of Access</i>? (CSA B651-23, 5.2.9.3(d)(iii)) e. fully open in not less than 3 seconds? (NB 3.8.3.6.6 (b)(i)) f. require a force of no more than 65 Newtons (15lbs) to stop the movement of the door? (NB 3.8.3.6.6 (b)(ii)) g. have a cane detectable guard on the hinged side of the door if it swings into the path of travel? (NB 3.8.3.6.6(7)) 				a. b. c. d. e. f. g.

4.0 INTERIOR FEATURES	YES	NO	N/A	MEASUREMENTS
<p>3. Are all interior doors:</p> <p>a. at least 86cm wide, excluding any hardware, when in the open wide position? (CSA B651-23, 5.2.1(a))</p> <p>b. colour contrasted from the surrounding walls or surfaces? (COP – Building Entrances)</p> <p>c. identified with tactile indicators, such as cane detectors or surface changes? (COP – Building Entrances)</p>				<p>a.</p> <p>b.</p> <p>c.</p>
<p>4. If doors have a fully glazed panel:</p> <p>a. is the panel transparent? (CSA B651-23, 5.2.10(a))</p> <p>b. does it have its lower edge no higher than 90cm from the floor? (CSA B651-23, 5.2.10(b))</p> <p>c. is it marked with a continuous opaque strip that is:</p> <ul style="list-style-type: none"> • colour contrasted with the door? (CSA B651-23, 5.2.10(c)(ii)) • at least 5cm high? (CSA B651-23, 5.2.10(c)(iii)) • extends the full width of the door? (CSA B651-23, 5.2.10(c)(iv)) • located between 135cm to 150cm from the floor? (CSA B651-23, 5.2.10(c)(iv)) 				<p>a.</p> <p>b.</p> <p>c.</p> <p>•</p> <p>•</p> <p>•</p> <p>•</p>
<p>5. From the pull side of the door, is there at least 150cm by 170cm clear, level floor area?(CSA B651-23, 5.2.2, Table 8)</p>				
<p>6. From the push side of the door, is there at least 150cm by 120cm clear, level floor area?(CSA B651-23, 5.2.2, Table 8)</p>				

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
7.	For a front approach to a swinging door: a. is there at least 30cm of clear space from the latch on the push side of the door?(CSA B651-23, 5.2.2, Figure 20a) b. is there at least 60cm of clear space from the latch on the pull side of the door? (CSA B651-23, 5.2.2, Figure 20a)				a. b.
8.	For a side approach (latch edge approach) to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20b)				
9.	For a hinge approach to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20c)				
10.	If there is a vestibule: a. is there at least 120cm width? (NB 3.8.3.6.12) b. is there a width between doors of at least 139cm plus the width of any door swinging into the space? (CSA B651-23, 5.2.5, Figure 21a; 21b)				a. b.
11.	Does the pushing or pulling force of the door not exceed: a. 22 Newtons (5lbs) for interior swinging doors?(CSA B651-23, 5.2.8(b)) b. 22 Newtons (5lbs) for sliding or folding doors?(CSA B651-23, 5.2.8(c))				a. b.

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
12.	<p>If there is a card reader:</p> <p>a. is the entry slot located between 80cm to 90cm from the floor? (CSA B651-23, 5.7.4.2.1(a)(i))</p> <p>b. is it colour contrasted from the wall or door? (CSA B651-23, 5.7.4.2.1(a)(iii))</p> <p>c. does it include tactile graphics on the surface to identify direction of card insertion? (CSA B651-23, 5.7.4.2.1(b)(ii))</p> <p>d. does it have audible signals to indicate opening? (CSA B651-23, 5.7.4.2.1(c))</p> <p>e. does it have visual signals to indicate opening? (CSA B651-23, 5.7.4.2.1(c))</p>				a. b. c. d. e.
13.	<p>If there is a proximity reader:</p> <p>a. is it located between 80cm to 120cm from the floor? (CSA B651-23, 5.7.4.2.2(a))</p> <p>b. does it have audible signals to indicate opening? (CSA B651-23, 5.7.4.2.2(b))</p> <p>c. does it have visual signals to indicate opening? (CSA B651-23, 5.7.4.2.2(b))</p>				a. b. c.
14.	<p>If there is a keypad:</p> <p>a. is it located between 80cm to 120cm from the floor? (CSA B651-23, 5.7.4.3(a))</p> <p>b. is it colour contrasted from the wall or door? (CSA B651-23, 5.7.4.3(b))</p> <p>c. does it have colour contrasted characters or numbers from the keys? (CSA B651-23, 5.7.4.3(c))</p> <p>d. if numeric, are there tactile graphics on the keys? (CSA B651-23, 5.7.4.3(d))</p>				a. b. c. d.

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
15.	Is there a minimum of 180cm unobstructed pathway to all areas of the facility, including in aisles? (COP - Corridors and Hallways)				
16.	Are there mirrors mounted in the upper corners of intersecting hallways to see if someone is around the corner? (CHH Best Practice 6.29)				
17.	Is there clear wayfinding signage from the main area leading to areas of high importance (e.g. accessible washrooms) that complies with Section 8.0 of the Accessibility Tool ?				
18.	Do rooms with access to the public (e.g. boardrooms, offices) have the room name and number displayed in a location visible to all? (ASNB)				
19.	If there are mats or runners: a. are they slip-resistant and secure? (CSA B651-23, 4.3.3(c)) b. do they have a thickness not more than 1.3cm ?(CSA B651-23, 4.3.3(b))				a. b.
20.	If there are vending machines, ATMs, or ticket payment machines, are the controls: a. operable with one hand using a closed fist or without tight grasping? (CSA B651-23, 4.3.4 (a)(i)) b. operable with a force of no more than 22 Newtons (5lbs) ?(CSA B651-23, 4.3.4 (b)) c. located at a height between 40cm to 120cm ? (CSA B651-23, 4.3.4, Figure 3)				a. b. c.

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
21.	<p>Does the service counter have:</p> <p>a. a lowered section no higher than 86.5cm from the floor and at least 76cm long? (NB 3.8.3.19(1)(a)(b))</p> <p>b. a clear, unobstructed floor area in front of the counter that is at least 80cm wide and 135cm long? (CSA B651-23, 6.7.1.1(a))</p> <p>c. tactile signage with braille to identify location? (COP - Tactile Signs)</p> <p>d. tactile direction surface indicators? (COP - Tactile Signs)</p> <p>e. colour contrast from the floor? (COP - Service Counters and Kiosks)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
22.	<p>Can a wheelchair or power scooter user access all primary areas, levels and amenities within the facility (e.g. restaurants, pools, meeting rooms, activities)? (NB 3.8.2.3)</p>				
23.	<p>Is there accessibility equipment (e.g. commodes, pool wheelchairs, lifts) available on site that:</p> <p>a. is in an identified location that is easy to find? (Ability NB Best Practice)</p> <p>b. can be reserved ahead of time? (Ability NB Best Practice)</p> <p>c. has readily available information online and at the site?(Ability NB Best Practice)</p> <p>d. is well-maintained? (Ability NB Best Practice)</p> <p>e. has staff trained to use it? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>

4.0 INTERIOR FEATURES		YES	NO	N/A	MEASUREMENTS
24.	Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? (Ability NB Best Practice)				
25.	Are building permit notices posted when doing renovations? (NBCAA, section 8)				
26.	Is flooring one solid colour with minimal gleam/shine? (COP - Floor Finishes); (ASNB)				
27.	Is the building well-illuminated with lighting in non-glaring placement? (COP - Lighting); (ASNB)				
28.	If the facility has seating areas (e.g. waiting areas, in front of mirrors in hair salons), does it comply with Section 4.1 of the Accessibility Tool ?				
29.	Does the facility provide a relief area for service animals that is: <ul style="list-style-type: none"> a. adjacent to an unobstructed accessible path of travel?(CK 4.3.19) b. located within 3000cm of an accessible entrance? (CK 4.3.19) c. located away from vehicular access routes? (CK 4.3.19) d. an artificial grassy area of at least 150cm by 150cm? (CK 4.3.19) e. equipped with a garbage can that complies with Section 19.0(3) of the Accessibility Tool? 				<ul style="list-style-type: none"> a. b. c. d. e.
30.	Are ceilings and other surfaces constructed of material (e.g. carpeting, ceiling sound buffers) that does not cause occasional noise to be unduly amplified? (BROCK 4.4.16)				

4.0 INTERIOR FEATURES	YES	NO	N/A	MEASUREMENTS
<p>31. When considering a sensory friendly environment:</p> <p>a. Is there limited background noise? (SFS)</p> <p>b. Is there sensory friendly ear protection provided? (SFS)</p> <p>c. Are all rooms and paths of travel well-illuminated without exceeding 500 lux except where there is natural light available? (COP – Lighting)</p> <p>d. If the building is lit with fluorescent lighting, are there blue light glasses available? (SFS)</p> <p>e. Is there comfortable seating provided in a quiet area? (SFS)</p> <p>f. Is the environment scent-free? (SFS)</p> <p>g. In businesses open to the public, are sensory friendly hours offered? (e.g. low lighting, no music, limited shoppers) (SFS)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p> <p>g.</p>

4.0 INTERIOR FEATURES	YES	NO	N/A	MEASUREMENTS
<p>32. Do water fountains/bottle filling stations:</p> <ul style="list-style-type: none"> a. have a location along an accessible route? (NB 3.8.3.10.1(a)) b. have a clear, unobstructed floor area of at least 82cm by 139cm in front of them? (CSA B651-23, 6.1.6(a), Figure 40) c. have knee clearance under the fountain that is at least 82cm wide, 20cm deep and 68.5cm in height? (CSA B651-23, 6.1.6(a), Figure 40) d. have a spout that is between 75cm and 90cm from the floor with a flow of water parallel to the front of the fountain? (CSA B651-23, 6.1.2(a)) e. operate with controls that are either automatic, located on the front or located on both sides of the fountain? (NB 3.8.3.10(e)(ii)) f. have colour contrast to the wall? (CSA B651-23, 6.1.5) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>33. If the water fountain/bottle filling station is cantilevered, is it cane-detectable or recessed with a toe space of at least 82cm wide, 23cm deep and 23cm high? (CSA B651-23, 6.1.6(c))</p>				

4.1 SEATING AREAS	YES	NO	N/A	MEASUREMENTS
1. Does the facility have a seating area (e.g. dining room, waiting room, lobby)? If "yes", proceed to next question. If "no", proceed to next section.				
2. How many designated wheelchair spaces does the location have? _____ out of _____ total fixed seats?				
3. Does the number of designated wheelchair spaces comply with Table 3.8.2.3 in the Barrier-Free Design Building Code NB Reg 2021-3 ?				
4. Is there an unobstructed accessible path of travel of at least 92cm wide in the seating areas? (NB 3.8.3.2.1)				
5. Does the path of travel have tactile direction surface indicators? (COP - Paths of Travel); (COP - Tactile Walking Surface Indicators)				
6. Are seating spaces clear and level with removable seats? (NB 3.8.3.21.1(a))				
7. If a person must transfer from their wheelchair, is there a safe, locked space available to store personal equipment (e.g. wheelchairs, walkers)? (Ability NB Best Practice)				
8. Is there seating in areas where long lines are anticipated? (TADG 2.4.4(3))				
9. Are benches or seats: a. stable or fixed? (CSA B651-23, 6.7.2.2(a)) b. at a seat height between 43cm and 48.5cm from the floor or adjustable? (CSA B651-23, 6.7.2.2(b)) c. available in a variety of seating styles (e.g. some with armrests, some without)? (CSA B651-23, 6.7.2.2(c))				a. b. c.

4.1 SEATING AREAS		YES	NO	N/A	MEASUREMENTS
10.	Are there two or more designated accessible seating spaces located side-by-side? (NB 3.8.3.21(c))				
11.	Is there colour contrast in the seating areas between: <ul style="list-style-type: none"> a. the floor and the walls? (COP - Colour and Brightness Contrast) b. the walls and the tables? (COP - Colour and Brightness Contrast) c. the table and chairs? (COP - Colour and Brightness Contrast) 				a. b. c.
12.	If the seating area is not visible from the accessible entrance, is there wayfinding signage that complies with Section 8.0 of the Accessibility Tool ?				
13.	Are spaces designated for wheelchair use: <ul style="list-style-type: none"> a. not less than 90cm wide to 152.5cm long to permit a wheelchair to enter from a side approach? (NB 3.8.3.23.2 (c)(i)) b. not less than 122cm long where the wheelchair enters from the front or rear of the space? (NB 3.8.3.21.1(b)) 				a. b.
14.	Is the lowest tabletop between 73cm and 86cm from the floor? (CSA B651-23, 6.7.1.2)				
15.	Is knee clearance underneath tables at least 68.5cm high by 82cm wide by 48cm deep? (CSA B651-23, 6.7.1.3)				
16.	If there is a bar, does it have a lowered section no more than 86.5cm from the floor? (NB 3.8.3.19.1(b))				

4.1 SEATING AREAS		YES	NO	N/A	MEASUREMENTS
17.	If there is a cafeteria-style tray slide, is the top located between 71cm to 86.5cm above the floor? (ADA 904.5.2)				
18.	If there are power outlets to allow recharging of batteries for electric mobility aids, are they between 45.5cm and 55cm from the floor? (NB 3.8.3.22.1(f))				
19.	If the seating area has a patio: <ul style="list-style-type: none"> a. is it adjacent to an accessible route? (CSA B651-23, 6.7.2.1(a)) b. does the entrance comply with Section 1.0 of the Accessibility Tool? c. does the seating comply with Section 4.1 of the Accessibility Tool? d. is there a minimum of 180cm unobstructed pathway to all areas of the patio, including aisles? (COP - Corridors and Hallways) 				<ul style="list-style-type: none"> a. b. c. d.

4.2 KITCHENS AND KITCHENETTES		YES	NO	N/A	MEASUREMENTS
1.	Does the facility have a kitchen or food preparation area? If "yes", proceed to next question. If "no", proceed to next section.				
2.	Is there a minimum of 120cm between counters and: <ul style="list-style-type: none"> a. opposing cabinets? (NB 3.8.3.23.4(a)) b. counters? (NB 3.8.3.23.4(a)) c. appliances? (NB 3.8.3.23.4(a)) d. walls? (NB 3.8.3.23.4(a)) 				a. b. c. d.
3.	Is there a clear floor area in front of appliances (e.g. refrigerators, ovens, dishwashers) of at least 82cm by 139cm ? (CSA B652, 5.10.1(c))				
4.	Can items, such as coffee makers or microwaves, be reached from a seated position? (CMHC - Kitchens)				
5.	Is there at least one work space that: <ul style="list-style-type: none"> a. is at least 75cm wide by 60cm deep? (NB 3.8.3.23.4(c)(i)) b. is 81cm to 86cm above the floor? (NB 3.8.3.23.4(c)(ii)) c. has a clear floor space in front of at least 75cm by 120cm? (NB 3.8.3.23.4(c)(iii)) d. has a knee clearance of at least 75cm wide by 48cm deep by 68cm high under the work surface? (NB 3.8.3.23.4(c)(iv)) e. has at least one electrical outlet located on the front or side of the work surface? (NB 3.8.3.23.4(c)(v)) 				a. b. c. d. e.

4.2 KITCHENS AND KITCHENETTES	YES	NO	N/A	MEASUREMENTS
<p>6. Do kitchen sinks:</p> <p>a. have the upper rim located between 81cm to 86cm from the floor? (NB 3.8.3.23.4(e)(i))</p> <p>b. have a knee clearance of 75cm wide by 25cm deep? (NB 3.8.3.23.4(e)(ii))</p> <p>c. have a toe space of 75cm wide by 23cm deep by 23cm high? (NB 3.8.3.23.4(e)(ii))</p> <p>d. have faucets with lever handles or hands-free sensors? (NB 3.8.3.23.4(e)(iv))</p> <p>e. have insulated pipes where the pipes are not located inside a cabinet? (NB 3.8.3.23.4(e)(v))</p>				a. b. c. d. e.
<p>7. Do upper cabinets have at least one shelf not more than 120cm from the floor? (NB 3.8.3.23.4(f))</p>				
<p>8. Do upper cabinets have pull-out and down systems available that enable the shelving to be reached from a seated position? (CMHC – Kitchens)</p>				
<p>9. Do cabinet doors and drawers have handles that are:</p> <p>a. easy to grasp? (NB 3.8.3.23.4(g))</p> <p>b. mounted at the top of base cabinets and at the bottom of upper cabinets? (NB 3.8.3.23.4(g))</p>				a. b.
<p>10. If there is a service counter, does it have a lowered section no more than 86.5cm from the floor? (NB 3.8.3.19.1(b))</p>				

4.3 SLEEPING ACCOMMODATIONS		YES	NO	N/A	MEASUREMENTS
1.	Does the facility have a designated sleeping area (e.g. hotel rooms, dormitories)? If "yes", proceed to next question. If "no", proceed to next section.				
2.	How many designated wheelchair accessible sleeping units are located in the facility? _____ out of _____ total rooms.				
3.	Does the number of designated accessible sleeping units comply with section 3.8.2.1(2) in the <i>Barrier-Free Design Building Code NB Reg 2021-3</i> ?				
4.	If there is an exterior door, does it comply with Section 1.0 of the Accessibility Tool ?				
5.	Do interior doors comply with Section 4.0 of the Accessibility Tool ?				
6.	Are door viewers at a height between 100cm to 120cm and 150cm to 170cm from the floor? (CSA B652-23, 5.7.8)				
7.	If the bed is not height adjustable, is the top of the mattress between 43cm to 46cm from the floor to make transferring from a mobility device easier? (CSA B652-23, 5.11.1(1))				
8.	Do any of the accessible guest rooms have two beds available to allow one bed for a caregiver? (Ability NB Best Practice)				
9.	Is there a clear floor area of at least 82cm by 139cm on at least one side of the bed and at least 82cm by 120cm on the other side?(CSA B652-23, 5.11.1.2, Figure 36c)				
10.	If there are windows in the sleeping space: <ul style="list-style-type: none"> a. are there window covers or shades to limit natural lighting and glares? (COP - Placement of light Fixtures) b. are the operating controls located between 40cm and 120cm from the floor? (CSA B651-23, 4.3.3) c. is the sill no higher than 75cm from the floor? (CSA B652-23, 4.9(b)) 				<ul style="list-style-type: none"> a. b. c.

4.3 SLEEPING ACCOMMODATIONS		YES	NO	N/A	MEASUREMENTS
11.	Is there colour contrast between the sleeping areas and the walls and floors? (COP - Colour and Brightness Contrast)				
12.	If there is a closet, does it have: <ul style="list-style-type: none"> a. a minimum clear opening of 90cm? (NB 3.8.3.23.2 (c)(i)) b. clothes hanger rods located at a height of 120cm? (NB 3.8.3.23.2(c)(ii)) c. at least one shelf located at a height of 137cm? (NB 3.8.3.23.2(c)(iii)) 				a. b. c.
13.	Are all the controls for heating, air conditioning and light switches unobstructed and no more than 120cm above the floor? (NB 3.8.3.22.1(e))				
14.	Do electrical outlets: <ul style="list-style-type: none"> a. have a height between 40cm and 55cm from the floor?(NB 3.8.3.23.1(d)) b. have a clear floor space of 139cm by 82cm in front of them? (CSA B651- 23, 4.3.2) 				a. b.
15.	Can items, such as telephones or clock radios, be reached from a seated position or the bed? (BAH 3.8.3.22.1))				
16.	Are computer network outlets or phone outlets unobstructed by furniture? (CSA B652-23, 5.11.6(c))				
17.	If there is a desk available, does it comply with Section 4.1 (11-13) of the Accessibility Tool?				
18.	Do night stands or desks have corner protectors to prevent injury from falls? (Ability NB Best Practice)				
19.	Do kitchenettes comply with Section 4.2 of the Accessibility Tool?				

4.3 SLEEPING ACCOMMODATIONS		YES	NO	N/A	MEASUREMENTS
20.	Is there accessibility equipment (e.g. commodes, bed lifts) available on site that: <ul style="list-style-type: none"> a. is in an identified location that is easy to find? (Ability NB Best Practice) b. can be reserved ahead of time? (Ability NB Best Practice) c. has readily available information online and at the site? (Ability NB Best Practice) d. is well-maintained? (Ability NB Best Practice) e. has staff trained to use it? (Ability NB Best Practice) 				a. b. c. d. e.
21.	Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? (Ability NB Best Practice)				
22.	Do trash bins have a clear floor area of at least 82cm by 139cm in front of them? (CSA B652-23, 4.4.2(a))				
23.	Do carpets: <ul style="list-style-type: none"> a. have a low, firm and level pile? (CSA B651-23, 4.4.3(a)) b. have a threshold, including any padding, no greater than 1.3cm high? (CSA B651-23, 4.4.3(b)) c. have secure fastening to the floor? (CSA B651-23, 4.4.3(c)) 				a. b. c.

4.3 SLEEPING ACCOMMODATIONS	YES	NO	N/A	MEASUREMENTS
24. If there is a balcony: <ul style="list-style-type: none"> a. is it adjacent to an accessible route? (CSA B652-23, 4.3.2(b)(i)) b. does the entrance comply with Section 1.0 of the Accessibility Tool? c. does it have a turning space of at least 180cm by 180cm? (CSA B652-23, 4.3.2(b)(iii)) d. is it illuminated to at least 50 lux at floor level? (CSA B652-23, 4.8.3, Table 3) 				a. b. c. d.
25. Does the facility have accommodations for service animals (e.g. water bowls in the rooms)? (GAPSA 6.0)				
26. Is there an emergency/evacuation plan in place (e.g. evacuation chairs, area of refuge) that complies with Section 9.0 of the Accessibility Tool ?				

5.0 WASHROOMS WITH STALLS		YES	NO	N/A	MEASUREMENTS
1.	Are accessible washrooms available for visitor use? If "yes", proceed to next question. If "no", proceed to next section.				
2.	Do the accessible washrooms have signage that complies with Section 8.0 of the Accessibility Tool ?				
3.	Do washroom doors open with low pressure using: <ul style="list-style-type: none"> a. a functioning power door? (NB 3.8.3.6.6) b. a functioning automatic sliding door? (NB 3.8.3.6.6(a)) c. lever handles at a height of 90cm to 110cm from the floor? (NB 3.8.3.6.4(b)) d. push plates or pull handles at a height 90cm to 110cm from the floor? (NB 3.8.3.4(b)) e. no door at all? 				<ul style="list-style-type: none"> a. b. c. d. e.

5.0 WASHROOMS WITH STALLS	YES	NO	N/A	MEASUREMENTS
<p>4. For power doors, do they:</p> <ul style="list-style-type: none"> a. have operable controls for hand activation located between 90cm and 110cm above floor level? (NB 3.8.3.6.6(a)(v)) b. have operable controls for foot activation located 15cm to 30cm above the floor? (NB 3.8.3.6.6(a)(v)) c. have controls that are located clear of the door swing and no more than 150cm from the door swing? (CSA B651-23, 5.2.9.2(c)) d. have controls marked with the International Symbol of Access? (CSA B651-23, 5.2.9.3(d)(iii)) e. fully open in not less than 3 seconds? (NB 3.8.3.6.6 (b)(i)) f. require a force of no more than 65N to stop the movement of the door? (NB 3.8.3.6.6 (b)(ii)) g. have a cane detectable guard on the hinged side of the door if it swings into the path of travel? (NB 3.8.3.6.6 (7)) 				<ul style="list-style-type: none"> a. b. c. d. e. f. g.
<p>5. Are washroom doors:</p> <ul style="list-style-type: none"> a. at least 86cm wide, excluding any hardware, when in the open wide position? (CSA B651-23 5.2.1(a)) b. colour contrasted from the surrounding walls or surfaces? (COP – Building Entrances) c. identified with tactile indicators, such as cane detectors or surface changes? (COP – Building Entrances) 				<ul style="list-style-type: none"> a. b. c.
<p>6. From the pull side of the door, is there at least 150cm by 170cm clear, level floor area? (CSA B651-23, 5.2.2, Table 8)</p>				

5.0 WASHROOMS WITH STALLS		YES	NO	N/A	MEASUREMENTS
7.	From the push side of the door, is there at least 150cm by 120cm clear, level floor area? (CSA B651-23, 5.2.2, Table 8)				
8.	For a front approach to a swinging door: <ul style="list-style-type: none"> a. is there at least 30cm of clear space from the latch on the push side of the door? (CSA B651-23, 5.2.2, Figure 20a) b. is there at least 60cm of clear space from the latch on the pull side of the door? (CSA B651-23, 5.2.2, Figure 20a) 				a. b.
9.	For a side approach (latch edge approach) to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20b)				
10.	For a hinge approach to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20c)				
11.	If there is a vestibule: <ul style="list-style-type: none"> a. is there at least 120cm width? (NB 3.8.3.6.12) b. is there a width between doors of at least 139cm plus the width of any door swinging into the space? (CSA B651-123, 5.2.5, Figure 21a; 21b) 				a. b.
12.	Does the pushing or pulling force of the door not exceed: <ul style="list-style-type: none"> a. 22 Newtons for interior swinging doors? (CSA B651-23, 5.2.8)(b)) b. 22 Newtons for sliding or folding doors? (CSA B651-23, 5.2.8(c)) 				a. b.
13.	Does the washroom have colour contrast between the walls, floor, sink area and stalls? (COP, "Design Basics, Colour and Brightness Contrast")				

5.0 WASHROOMS WITH STALLS		YES	NO	N/A	MEASUREMENTS
14.	Is the washroom free of potential tripping hazards such as fountains, trash cans or dispensers? (COP - Protruding Objects and Other Obstacles)				
15.	Are controls for supply dispensers (e.g. sanitary napkins, condoms) located no higher than 120cm from the floor?(CSA B651-23, 4.3.3)				
16.	Does the washroom have: a. tactile walking surface indicators? (COP - Guidance Tactile Walking Surface Indicators) b. tactile signage with braille indicating the accessible stalls? (COP - Guidance Tactile Walking Surface Indicators)				a. b.
17.	When considering a sensory friendly environment, is the washroom scent-free (e.g. no strong air fresheners)? (SFS)				
18.	Are baby change tables: a. mounted with its top no higher than 86cm from the floor?(CSA B651-23, 6.2.3.1(b)) b. mounted with a knee clearance of at least 68.5cm high? (CSA B651-23, 6.2.3.1(c)) c. no deeper than 60cm from the front of the table to the wall? (CSA B651-23, Annex A.2.2) d. within a reach of no more than 50cm from a seated position? (CSA B651-23, Annex A.2.2) e. mounted without impeding paths of travel or transfer spaces? (ADA 604.8.1.1) f. colour contrasted from the wall? (COP - Washrooms and Shower Stalls)				a. b. c. d. e. f.

5.1 SINK AREAS	YES	NO	N/A	MEASUREMENTS
1. Does the sink have a clearance not less than: <ul style="list-style-type: none"> a. 76cm wide? (NB 3.8.3.15.1(d)(i)) b. 73.5cm high at the front edge? (NB 3.8.3.15.1(d)(ii)) c. 68.5cm high from the floor at a point 20.5cm back from the front edge? (NB 3.8.3.15.1(d)(iii)) d. 23cm high from the floor at a point 28cm to 43cm back from the front edge?(NB 3.8.3.15.1(d)(iv)) 				<ul style="list-style-type: none"> a. b. c. d.
2. Does the sink have insulated pipes to prevent a burn hazard? (NB 3.8.3.15.1(e))				
3. Is the mirror mounted: <ul style="list-style-type: none"> a. with its bottom edge not more than 100cm from the floor? (NB 3.8.3.15.2(a)) b. in a fixed, inclined position? (NB 3.8.3.15.2(b)) 				<ul style="list-style-type: none"> a. b.
4. Are light fixtures around or near mirrors positioned to avoid glares or shadows? (COP - Placement of Light Fixtures)				
5. Is the soap dispenser located, within a 50cm reach of a person in a sitting position? (NB 3.8.3.15.2(f))				
6. Is the soap dispenser no higher than 110cm above the floor? (NB 3.8.3.15.2(f))				
7. Is the soap dispenser automatic or operable with one hand to dispense soap in the palm of the hand? (NB 3.8.3.15.2(f)(ii))				
8. Is the hand dryer or towel dispenser located within a 50cm reach of a person in a sitting position? (CSA B651-23, 6.2.4.4(a))				

5.1 SINK AREAS	YES	NO	N/A	MEASUREMENTS
9. Is the center of the operating control of the hand dryer or towel dispenser no higher than 120cm from the floor? (NB 3.8.3.15.2)				
10. Is the hand dryer or towel dispenser automatic or operable with one hand? (CSA B651-23, 6.2.4.4(c))				
11. Are the faucets either automatic or lever-type handles that do not have spring action and are operable with a closed fist? (NB 3.8.3.15.1(a))				

5.2 ACCESSIBLE STALLS	YES	NO	N/A	MEASUREMENTS
1. How many designated accessible stalls are located within the washroom? _____ of _____ total stalls. If 1 or more, proceed to next question. If none, proceed to next section.				
2. Does the number of designated accessible stalls comply with Table 3.8.2.3.B of Ontario Building Code Act?				
3. Is there a clear, unobstructed path of travel from the entrance to the accessible stall? (COP - Path of Travel)				
4. Does the stall have a minimum of 210cm by 210cm of maneuvering/turning space in front of the stall? (CSA B651-23, 6.2.7.2(g))				
5. Does the stall door have signage that complies with Section 8.0 of the Accessibility Tool? (NB 3.8.2.10)				
6. Does the stall door: a. provide a clear opening of at least 86cm with the door in the open wide position? (CSA B651-23, 6.2.7.2(a)) b. open outward? (CSA B651-23, 6.2.7.3(c)(i)) c. self-close when at rest so it is not open more than 5cm ? (CSA B651-23, 6.2.7.3(c)(ii)) d. latch from the inside by a lock that can be operated from a closed fist position? (CSA B651-23, 6.2.7.3(c)(iii)) e. have a pull handle on both sides? (NB 3.8.3.6 (iii))				a. b. c. d. e.
7. If the door swings inward, is there a clear floor space of at least 80cm by 135cm in addition to the width of the door? (NB 3.8.3.11(1)(c)(v))				

5.2 ACCESSIBLE STALLS	YES	NO	N/A	MEASUREMENTS
<p>8. Is the exterior pull handle:</p> <p>a. a "D" style in shape? (CSA B651-23, 6.2.7.2(d))</p> <p>b. at least 14cm long? (CSA B651-23, 6.2.7.2(d))</p> <p>c. mounted horizontally with its centreline located 12cm to 22cm from the latch edge of the door? (CSA B651-23, 6.2.7.2(d)(i))</p> <p>d. mounted 80cm to 100cm from the floor? (CSA B651-23, 6.2.7.2(d)(ii))</p>				a. b. c. d.
<p>9. Is the interior pull handle:</p> <p>a. "D" style in shape? (CSA B651-23, 6.2.7.2(c))</p> <p>b. at least 14cm long? (CSA B651-23, 6.2.7.2(c))</p> <p>c. mounted horizontally with its centreline located 20cm to 30cm from the hinge edge? (CSA B651-23, 6.2.7.2(c)(i))</p> <p>d. mounted 80cm to 100cm from the floor? (CSA B651-23, 6.2.7.2(c)(ii))</p>				a. b. c. d.
<p>10. Is the stall door locking mechanism operable with a closed fist and located at least 90cm and not more than 100cm above the floor? (NB 3.8.3.11(1)(c)(i))</p>				
<p>11. Is the interior space of the stall 160cm by 150cm or greater? (CSA B651-23, 6.2.7.1(a))</p>				
<p>12. Is there 46cm to 48cm distance from between the centreline of the toilet and the wall on one side? (NB 3.8.3.11(d))</p>				

5.2 ACCESSIBLE STALLS		YES	NO	N/A	MEASUREMENTS
13.	Is the toilet seat: <ul style="list-style-type: none"> a. located at a height (from floor to the top of the seat) between 43cm and 46cm? (NB 3.8.3.13(1)(a)) b. not spring activated so user does not have to manually hold down seat during transfer? (CSA B651-23, 6.2.6.1(b)) c. equipped with back support where there is no water tank or seat lid? (CSA B651-23, 6.2.6.1(c)) 				a. b. c.
14.	If the toilet has a water tank, is the tank lid secure? (CSA B651-23, 6.2.6.1(d))				
15.	Does the toilet flush automatically or does it have operating controls located between 50cm to 90cm from the floor and no further than 35cm from transfer space? (NB 3.8.3.13(1)(d)(i))				
16.	Does the toilet have a back support to reduce the chance of imbalance or injury? (NB 3.8.3.13(1)(c))				
17.	Is there a side grab bar that: <ul style="list-style-type: none"> a. is mounted on the side wall closest to the toilet? (NB 3.8.3.11(1)(e)(i)) b. has horizontal and vertical bars at least 76cm long? (NB 3.8.3.11(1)(e)(ii)) c. has a horizontal bar mounted between 75cm and 85cm above the floor? (NB 3.8.3.11(1)(e)(ii)) d. is 3cm to 4cm in diameter? (CSA B651-23, 6.2.5.1(b)) e. has a clearance of 3.5cm and 4.5cm from the wall? (CSA B651-23, 6.2.5.1(c)) f. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				a. b. c. d. e. f.

5.2 ACCESSIBLE STALLS	YES	NO	N/A	MEASUREMENTS
<p>18. Is there a rear grab bar that:</p> <ul style="list-style-type: none"> a. is mounted horizontally on the rear wall? (NB 3.8.3.11(1)(f)) b. is centered on the toilet bowl that extends no less than 30cm in both directions? (NB 3.8.3.11(1)(f)) c. is mounted either 75cm to 85cm above the floor or 10cm above the water tank? (NB 3.8.3.11(1)(e)(ii)) d. is 3cm to 4cm in diameter? (CSA B651-23, 6.2.5.1(b)) e. has a clearance of 3.5cm to 4.5cm from the wall? (CSA B651-23, 6.2.5.1(c)) f. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>19. Is the toilet paper dispenser:</p> <ul style="list-style-type: none"> a. mounted below the grab bar without obstructing its use? (OBC 3.8.3.8.1(g)(ii)) b. in line with or not more than 30cm in front of the toilet seat? (NB 3.8.3.11(h)(ii)) c. located 60cm to 80cm above the floor? (NB 3.8.3.11(1)(h)(i)) d. made of an open design that does not impede access by encasing the toilet paper? (Ability NB Best Practice) e. colour contrasted from the wall? (COP - Washrooms and Shower Stalls) 				<ul style="list-style-type: none"> a. b. c. d. e.

5.2 ACCESSIBLE STALLS		YES	NO	N/A	MEASUREMENTS
20.	<p>Is there a coat hook that:</p> <p>a. is located on the side wall? (CSA B651-23, 6.2.7.1(c))</p> <p>b. is colour contrasted from the wall? (COP – Washrooms and Shower Stalls)</p> <p>c. is not more than 120cm from the floor? (NB 3.8.3.11(g))</p> <p>d. projects not more than 4cm from the wall? (CSA B651-23, 6.2.7.1(c)(ii))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
21.	<p>Does the stall have a shelf or counter for medical supplies, purses, etc., that is:</p> <p>a. no higher than 120cm? (Ability NB Best Practice)</p> <p>b. at least 20cm wide by 40cm long? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p>
22.	Does the stall have an emergency call button? (Ability NB Best Practice)				

5.3 URINALS	YES	NO	N/A	MEASUREMENTS
1. Are the urinals wall-mounted or in a stall with the opening of the basin no higher than 43cm from the floor? (NB 3.8.3.14(1)(a))				
2. Does the urinal have a clear floor area, centered and in front, of at least 82cm wide and 139cm deep and unobstructed by privacy screens? (CSA B651-23, 6.2.8.1(b)(iii))				
3. Is there a flush control that is automatic or located between 90cm and 110cm from the floor? (NB 3.8.3.14.1(e)(ii))				
4. Are the flush controls operable with one hand without tight grasping or twisting? (NB 3.8.3.14.1(e))				
5. Are there grab bars that: <ul style="list-style-type: none"> <li data-bbox="170 675 936 743">a. are vertically mounted on both sides of the urinal? (NB 3.8.3.14(1)(f)) <li data-bbox="170 773 621 841">b. are at least 60cm in length? (NB 3.8.3.14(1)(f)(ii)) <li data-bbox="170 870 894 980">c. are mounted with the center of the bar located 100cm from the floor? (NB 3.8.3.14(1)(f)(ii)) <li data-bbox="170 1010 989 1114">d. are mounted no more than 38cm to the side from the center of the urinal? (NB 3.8.3.14(1)(f)(iii)) <li data-bbox="170 1143 737 1211">e. are colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				<ul style="list-style-type: none"> <li data-bbox="1381 675 1409 704">a. <li data-bbox="1381 773 1409 802">b. <li data-bbox="1381 870 1409 899">c. <li data-bbox="1381 1010 1409 1039">d. <li data-bbox="1381 1143 1409 1172">e.

5.3 URINALS	YES	NO	N/A	MEASUREMENTS
6. Does the urinal have a centerline indicator that:				
a. is centered on the urinal? (CSA B651-23, 6.2.8.3(a))				a.
b. Is mounted not less than 15cm above the upper rim and extends to a height of at least 130cm from the floor? (CSA B651-23, 6.2.8.3(b))				b.
c. is at least 5cm wide? (CSA B651-23, 6.2.8.3(c))				c.
d. is raised at least 3mm from the wall surface? (CSA B651-23, 6.2.8.3(d))				d.
e. is colour contrasted to the back wall? (CSA B651-23, 6.2.8.3(e))				e.

5.4 UNIVERSAL WASHROOMS	YES	NO	N/A	MEASUREMENTS
1. Is there a universal washroom available for visitor use? If "yes", proceed to next question. If "no", proceed to next section.				
2. Is the washroom identified by a sign that: a. complies with Section 8.0 of the Accessibility Tool ? b. shows a male, female or gender-neutral graphic and the <i>International Symbol of Access</i> ? (CSA B651-23, 6.3.1.1(d)(ii))				a. b.
3. Do washroom doors open with low pressure using: a. a functioning power door? (NB 3.8.3.6.6) b. a functioning automatic sliding door? (NB 3.8.3.6.6(a)) c. lever handles at a height of 90cm to 110cm from the floor? (NB 3.8.3.6.4(b)) d. push plates or pull handles at a height 90cm to 110cm from the floor? (NB 3.8.3.4(b)) e. no door at all?				a. b. c. d. e.

5.4 UNIVERSAL WASHROOMS	YES	NO	N/A	MEASUREMENTS
<p>4. For power doors, do they:</p> <p>a. have operable controls for hand activation located between 90cm and 110cm above floor level? (NB 3.8.3.6.6(a)(v))</p> <p>b. have operable controls for foot activation located 15cm to 30cm above the floor? (NB 3.8.3.6.6(a)(v))</p> <p>c. have controls that are located clear of the door swing and no more than 150cm from the door swing? (CSA B651-23, 5.2.9.2(c))</p> <p>d. have controls marked with the International Symbol of Access? (CSA B651-23, 5.2.9.3(d)(iii))</p> <p>e. fully open in not less than 3 seconds? (NB 3.8.3.6.6 (b)(i))</p> <p>f. require a force of no more than 65 Newtons to stop the movement of the door? (NB 3.8.3.6.6 (b)(ii))</p> <p>g. have a cane detectable guard on the hinged side of the door if it swings into the path of travel? (NB 3.8.3.6.6 (7))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p> <p>g.</p>
<p>5. Are washroom doors:</p> <p>a. at least 86cm wide, excluding any hardware, when in the open wide position? (CSA B651-23, 5.2.1(a))</p> <p>b. colour contrasted from the surrounding walls or surfaces? (COP – Building Entrances)</p> <p>c. identified with tactile indicators, such as cane detectors or surface changes? (COP – Building Entrances)</p>				<p>a.</p> <p>b.</p> <p>c.</p>
<p>6. From the pull side of the door, is there at least 150cm by 170cm clear, level floor area?(CSA B651-23, 5.2.2, Table 8)</p>				

5.4 UNIVERSAL WASHROOMS		YES	NO	N/A	MEASUREMENTS
7.	From the push side of the door, is there at least 150cm by 120cm clear, level floor area? (CSA B651-23, 5.2.2, Table 8)				
8.	For a front approach to a swinging door: <ul style="list-style-type: none"> a. is there at least 30cm of clear space from the latch on the push side of the door? (CSA B651-23, 5.2.2, Figure 20a) b. is there at least 60cm of clear space from the latch on the pull side of the door? (CSA B651-23, 5.2.2, Figure 20a) 				a. b.
9.	For a side approach (latch edge approach) to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door? (CSA B651-23, 5.2.2, Figure 20b)				
10.	For a hinge approach to a swinging door, is there at least 60cm of clear space from the latch on both sides of the door?(CSA B651-23, 5.2.2, Figure 20c)				
11.	If there is a vestibule: <ul style="list-style-type: none"> a. is there at least 120cm width? (NB 3.8.3.6.12) b. is there a width between doors of at least 139cm plus the width of any door swinging into the space? (CSA B651-23, 5.2.5, Figure 21a, 21b) 				a. b.
12.	Does the pushing or pulling force of the door not exceed: <ul style="list-style-type: none"> a. 22 Newtons for interior swinging doors? (CSA B651-23, 5.2.8(b)) b. 22 Newtons for sliding or folding doors? (CSA B651-23, 5.2.8(c)) 				a. b.
13.	Does the washroom have colour/brightness contrast between the walls, floor and sink area? (COP - Colour and Brightness Contrast)				

5.4 UNIVERSAL WASHROOMS		YES	NO	N/A	MEASUREMENTS
14.	Is the washroom free of potential tripping hazards such as trash cans or dispensers? (COP - Protruding Objects and Other Obstacles)				
15.	When considering a sensory friendly environment, is the washroom scent-free (e.g. no strong air fresheners)? (SFS)				
16.	Does the washroom have: <ul style="list-style-type: none"> a. tactile walking surface indicators? (COP - Guidance Tactile Walking Surface Indicators) b. tactile signage with braille indicating the location of the washroom?(COP - Guidance Tactile Walking Surface Indicators) 				a. b.
17.	Is there 90cm clear space on at least one side of the toilet? (NB 3.8.3.12.1(d))				
18.	Is the toilet seat: <ul style="list-style-type: none"> a. at a height (from floor to the top of the seat) between 43cm and 46cm? (NB 3.8.3.13(1)(a)) b. not spring activated so user does not have to manually hold down seat during transfer? (CSA B651-23, 6.2.6.1(b)) c. equipped with back support where there is no water tank or seat lid? (CSA B651-23, 6.2.6.1(c)) 				a. b. c.
19.	If there is a water tank, is the tank lid secure? (CSA B651-23, 6.2.6.1(d))				
20.	Does the toilet flush automatically or does it have operating controls located between 50cm to 90cm from the floor? (NB 3.8.3.13)				

5.4 UNIVERSAL WASHROOMS	YES	NO	N/A	MEASUREMENTS
<p>21. Is there a side grab bar that:</p> <ul style="list-style-type: none"> a. is mounted on the side wall closest to the toilet? (NB 3.8.3.11(e)(i)) b. has horizontal and vertical bars at least 76cm long? (NB 3.8.3.11(e)(ii)) c. has a horizontal bar mounted between 75cm and 85cm above the floor? (NB 3.8.3.11(e)(ii)) d. is 3cm to 4cm in diameter? (CSA B651-23, 6.2.5.1(b)) e. has a clearance of 3.5cm to 4.5cm from the wall? (CSA B651-23, 6.2.5.1(c)) f. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>22. Is there a rear grab bar that:</p> <ul style="list-style-type: none"> a. is mounted horizontally on the rear wall? (NB 3.8.3.11(f)) b. is centered on the toilet bowl that extends no less than 30cm in both directions? (NB 3.8.3.11(f)) c. is mounted either 75cm to 85cm above the floor or 10cm above the water tank? (NB 3.8.3.11(e)(ii)) d. is 3cm to 4cm in diameter? (CSA B651-23, 6.2.5.1(b)) e. has a clearance of 3.5cm to 4.5cm from the wall? (CSA B651-23, 6.2.5.1(c)) f. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				<ul style="list-style-type: none"> a. b. c. d. e. f.

5.4 UNIVERSAL WASHROOMS		YES	NO	N/A	MEASUREMENTS
23.	<p>Is the toilet paper dispenser:</p> <p>a. mounted below the grab bar without obstructing its use? (OBC 3.8.3.8.1(g)(ii))</p> <p>b. in line with or not more than 30cm in front of the toilet seat? (NB 3.8.3.11(h)(ii))</p> <p>c. located 60cm to 80cm above the floor? (NB 3.8.3.11(1)(h)(i))</p> <p>d. made of an open design that does not impede access by encasing the toilet paper? (Ability NB Best Practice)</p> <p>e. colour contrasted from the wall? (COP – Washrooms and Shower Stalls)</p>				a. b. c. d. e.
24.	Are controls for supply dispensers (e.g. sanitary napkins, condoms) located no higher than 120cm from the floor?(CSA B651-23, 4.2.3)				
25.	Is there a coat hook on the side wall that is not more than 120cm from the floor and projects not more than 4cm from the wall? (CSA B651-23, 6.8.1(c))				
26.	<p>Does the washroom provide a shelf or counter for medical supplies, purses, etc., that is:</p> <p>a. no higher than 120cm? (NB 3.8.3.12 (h))</p> <p>b. at least 20cm wide by 40cm long? (CSA B651-23, 6.3.3(b))</p>				a. b.

5.4 UNIVERSAL WASHROOMS	YES	NO	N/A	MEASUREMENTS
<p>27. Is the washroom equipped with an adult change table that:</p> <ul style="list-style-type: none"> a. is at least 76cm wide by 183cm long? (CSA B651-23, 6.3.4.1(b)) b. has a surface height above the floor that can be adjusted from between 45cm and 50cm at the low range and to between 85cm and 90cm at the high range? (CSA B651-23, 6.3.4.1(c)) c. has surfaces free of sharp edges, corners, or abrasive materials? (CSA B651-23, 6.3.4.1(d)) d. is easy to clean? (CSA B651-23, 6.3.4.1(e)) e. is designed to support a weight of at least 250kg (551lbs)? (CSA B651-23, 6.3.4.1(f)) f. has controls no higher than 120cm? (CSA B651-23, 6.3.4.3) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>28. Does the adult change table have a transfer space that:</p> <ul style="list-style-type: none"> a. is 90cm wide by 150cm long? (CSA B651-23, 6.3.4.2) b. is adjacent to the table? (CSA B651-23, 6.3.4.2) c. does not impede the clear transfer space when in position for use? (CSA B651-23, 6.3.4.3) 				<ul style="list-style-type: none"> a. b. c.

5.4 UNIVERSAL WASHROOMS	YES	NO	N/A	MEASUREMENTS
<p>29. Does the adult change table have a grab bar that:</p> <ul style="list-style-type: none"> a. is centered on the long dimension of the bench? (CSA B651-23, 6.3.4.1(g)(ii)) b. is at least 120cm long? (CSA B651-23, 6.3.4.1(g)(iii)) c. is mounted so that it can be used regardless of the bench height adjustment? (CSA B651-23, 6.3.4.1(g)(iv)) d. is slip-resistant? (CSA B651-23, 6.2.5.1(a)) e. has a diameter between 3cm and 4cm? (CSA B651-23, 6.2.5.1(b)) f. has a space between 3.5cm and 4.5cm between the wall and the grab bar? (CSA B651-23, 6.2.5.1(c)) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>30. Are baby change tables:</p> <ul style="list-style-type: none"> a. mounted with its top no higher than 86cm from the floor?(CSA B651-23, 6.2.3.1(b)) b. mounted with a knee clearance of at least 68.5cm high? (CSA B651-23, 6.2.3.1(c)) c. no deeper than 60cm from the front of the table to the wall? (CSA B651-23, Annex A.2.2) d. within a reach of no more than 50cm from a seated position? (CSA B651-23, Annex A.2.2) e. mounted without impeding paths of travel or transfer spaces? (ADA 604.8.1.1)) f. colour contrasted from the wall? (COP - Washrooms and Shower Stalls) 				<ul style="list-style-type: none"> a. b. c. d. e. f.

5.4 UNIVERSAL WASHROOMS		YES	NO	N/A	MEASUREMENTS
31.	<p>Does the washroom have:</p> <p>a. an emergency call system that can be activated by a control located inside the washroom which will activate audible and visual signal devices inside and outside of the washroom? (CSA B651-23, 6.3.1.2)</p> <p>b. signage with lettering at least 2.5cm and posted above the emergency button to indicate that signal devices will activate when the button is pushed? (CSA B651-23, 6.3.1.2)</p> <p>c. signage posted outside the washroom with instructions to passersby on how to retrieve the washroom key, open the door, and render assistance in the event of an emergency? (CSA B651-23, 6.3.1.2)</p>				<p>a.</p> <p>b.</p> <p>c.</p>
32.	<p>Does the sink have a clearance not less than:</p> <p>a. 76cm wide? (NB 3.8.3.15.1(d)(i))</p> <p>b. 73.5cm high at the front edge? (NB 3.8.3.15.1(d)(ii))</p> <p>c. 68.5cm high from the floor at a point 20.5cm back from the front edge? (NB 3.8.3.15.1(d)(iii))</p> <p>d. 23cm high from the floor at a point 28cm to 43cm back from the front edge? (NB 3.8.3.15.1(d)(iv))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
33.	<p>Does the sink have insulated pipes to prevent a burn hazard? (NB 3.8.3.15.1(e))</p>				
34.	<p>Is the mirror mounted:</p> <p>a. with its bottom edge not more than 100cm from the floor? (NB 3.8.3.15.2(a))</p> <p>b. in a fixed, inclined position? (NB 3.8.3.15.2(b))</p>				<p>a.</p> <p>b.</p>

5.4 UNIVERSAL WASHROOMS		YES	NO	N/A	MEASUREMENTS
35.	Are light fixtures around or near mirrors positioned to avoid glares or shadows? (COP - Placement of Light Fixtures)				
36.	Is the soap dispenser unobstructed, within a 50cm reach of a person in a sitting position? (NB 3.8.3.15.2(f))				
37.	Is the soap dispenser no higher than 110cm above the floor? (NB 3.8.3.15.2(f))				
38.	Is the soap dispenser automatic or operable with one hand to dispense soap in the palm of the hand? (NB 3.8.3.15.2(f)(ii))				
39.	Is the hand dryer or towel dispenser located within a 50cm reach of a person in a sitting position?(CSA B651-23, 6.2.4.4(a))				
40.	Is the center of the operating control of the hand dryer or towel dispenser no higher than 120cm from the floor? (NB 3.8.3.15.2)				
41.	Is the hand dryer or towel dispenser automatic or operable with one hand? (CSA B651-23, 6.2.4.4(c))				
42.	Are the faucets either automatic or lever-type handles that do not have spring action and are operable with a closed fist? (NB 3.8.3.15.1(a))				

5.5 SHOWERS	YES	NO	N/A	MEASUREMENTS
1. If there is a group of shower stalls available for use, is there at least one accessible, roll-in shower unit? (NB 3.8.2.8.12)				
2. Does the number of designated roll-in accessible stalls comply with Table 3.8.3.13 in the <i>Ontario Building Code</i> ?				
3. Do shower stalls have: a. tactile walking surface indicators? (COP - Guidance Tactile Walking Surface Indicators) b. tactile signage with braille indicating the locations of the accessible stalls? (COP - Guidance Tactile Walking Surface Indicators)				a. b.
4. Is there a clear, slip-resistant floor area in front of the shower of at least 90cm deep by 150cm wide? (CSA B651-23, 6.5.5.2)				
5. Does the interior of the shower stall have a clear floor space, excluding any hardware or fixed benches, of at least 90cm deep by 150cm wide? (NB 3.8.3.16.1(a))				
6. Do the shower stalls have tactile walking surface indicators indicating the entrance? (COP - Attention TWSI) (COP - Tactile Signs)				
7. Do the walls and floors have colour/brightness contrast? (COP - Colour and Brightness Contrast)				
8. Is there lighting available inside the shower stall? (Ability NB Best Practice)				

5.5 SHOWERS		YES	NO	N/A	MEASUREMENTS
9.	Does the shower entry have either: a. a clear, level threshold of 1.3cm or less? (NB 3.8.3.16.1(e)) b. a slope no more than 1:2 (50%) where it is higher than 0.6cm ? (NB 3.8.3.16.1(e)) c. a water dam that flattens when wheeled over or stepped on? (CMHC – Bathrooms)				a. b. c.
10.	If the shower stall has a shower curtain, does it hang at least 2.5cm off the floor? (CMHC – Bathrooms)				
11.	Does the shower have a pressure equalizing or thermostatic valve that: a. is controlled by a lever or other device operable with a closed fist from a seated position? (NB 3.8.3.16.1(h)) b. is mounted on the wall opposite the entrance to the shower? (NB 3.8.3.16.1(h)(i))				a. b.
12.	Does the shower have a hand-held showerhead that: a. has a hose that is at least 180cm long and mounted to be adjustable between 120cm to 203cm from the floor? (NB 3.8.3.16.1(h)(i)) b. can be reached from a seated position? (NB 3.8.3.16(h)(i)) c. does not obstruct grab bars? (NB 3.8.3.16.1(h)(iii))				a. b. c.
13.	Are facility/housekeeping staff trained to leave hoses at the lowest height? (Ability NB Best Practice)				
14.	Is the water temperature not more than 49 C (120 F) ? (CSA B651-23, 6.5.1)				

5.5 SHOWERS		YES	NO	N/A	MEASUREMENTS
15.	Does the shower head have a multi-function spray that has adjustable pressure? (CMHC – Bathrooms)				
16.	Does the shower have recessed soap holders that can be reached from a seated position? (NB 3.8.3.16(j))				
17.	Does the shower floor have a slip-resistant floor, even when wet? (NB 3.8.3.16.1(d))				
18.	Does the shower floor slope minimally to provide proper drainage? (CSA B651-23, 6.5.4(b))				
19.	Is there a permanent, secure grab bar that: <ul style="list-style-type: none"> a. is mounted vertically on the side wall 5cm to 8cm from the outside of the shower stall?(NB 3.8.3.16(1)(f)(i)) b. is at least 100cm long? (NB 3.8.3.16(1)(f)(ii)) c. is mounted with its bottom end between 60cm and 65cm from the floor? (NB 3.8.3.16(1)(f)(iii)) d. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				a. b. c. d.
20.	Is there a permanent, secure grab bar that: <ul style="list-style-type: none"> a. is L-shaped and mounted on the wall opposite the entrance of the shower stall? (NB 3.8.3.16(1)(f)(iii)) b. is mounted with the horizontal end not less than 100cm long? (NB 3.8.3.16(1)(f)(iii)) c. is mounted with the horizontal end between 75cm and 85cm high from the floor? (NB 3.8.3.16(1)(f)(iii)) d. is mounted with the vertical end not less than 75cm long and between 40cm to 50cm from the side wall where the other bar is located? (NB 3.8.3.16(1)(f)(iii)) e. is colour contrasted from the wall? (COP - Colour and Brightness Contrast) 				a. b. c. d. e.

5.5 SHOWERS		YES	NO	N/A	MEASUREMENTS
21.	Does the shower have a bath bench that: <ul style="list-style-type: none"> a. is hinged (not spring-loaded) or fixed? (NB 3.8.3.16.1(g)) b. is located on the same wall as the vertically mounted grab bar? (NB 3.8.3.16.1(g)(ii)) c. is mounted between 43cm and 48.5cm above the floor? (CSA B651-23, 6.5.5.6(c)) d. can support a minimum load of 1300 Newtons (292 lbs)? (NB 3.8.3.16(g)(iii)) e. is smooth and slip-resistant with no rough edges? (NB 3.8.3.16.1(g)) f. is colour contrasted to the wall? (COP – Washrooms and Shower Stalls) 				a. b. c. d. e. f.
22.	Are rectangular bath benches not less than 45cm wide and 40cm deep? (NB 3.8.3.16(g)(i))				
23.	Are L-shaped bath benches not less than 38cm deep on both ends? (ADA 610.3.2)				
24.	Are there towel racks or hooks that: <ul style="list-style-type: none"> a. are located within a 50cm reach of a person in a sitting position? (CSA B651-23, 6.2.4.4(a)) b. are located on the side wall? (NB 3.8.3.11(1)(g)) c. are not more than 110cm from the floor? (CSA B652-23, 5.9.13.9) d. project not more than 5cm from the wall? (NB 3.8.3.11(1)(g)) 				a. b. c. d.

5.6 BATHTUBS	YES	NO	N/A	MEASUREMENTS
1. Is there a bathtub in the facility? If “yes”, proceed to next question. If “no”, proceed to next section.				
2. Is the bathtub located in a washroom with a clear, unobstructed floor space that measures at least 150cm wide by 150cm long? (NB 3.8.3.11.1(a)(b))				
3. Is the bathtub at least 150cm in length with no tracks or other obstacles on its edge? (NB 3.8.3.17(1)(b)(d))				
4. Is there an unobstructed, slip-resistant floor area of 90cm wide along the whole length of the outside of the tub? (CSA B651-23, 6.5.6.1)				
5. Do the walls, floors and tub have colour contrast? (COP - Colour and Brightness Contrast)				
6. Are the faucets: <ul style="list-style-type: none"> a. operable with one hand without tight grasping (lever or hands-free/sensory)? (CSA B651-23, 6.2.3.3(a)) b. located at the foot end of the tub between the centreline and the exterior edge of the rim, at no more than 45cm above the rim? (NB 3.8.3.17(1)(e)(ii)) 				a. b.
7. Does the tub have a hand-held showerhead that: <ul style="list-style-type: none"> a. has a hose that is at least 180cm long and mounted to be adjustable between 120cm to 203cm from the floor? (NB 3.8.3.17.1(h)) b. can be reached from a seated position? (NB 3.8.3.17(h)) c. does not obstruct grab bars? (NB 3.8.3.16.1(h)(iii)) 				a. b. c.
8. Are facility/housekeeping staff trained to leave hoses at the lowest height? (Ability NB Best Practice)				

5.6 BATHTUBS		YES	NO	N/A	MEASUREMENTS
9.	Is the water temperature not more than 49 C (120 F) ? (CSA B651-23, 6.2.3.4)				
10.	Is there a permanent, secure horizontal grab bar along the length of the bathtub that: a. has its lower end mounted 18cm to 28cm above the bathtub rim? (NB 3.8.3.17(1)(f)(iv)) b. at least 120cm in length? (NB 3.8.3.17(1)(f)(ii))				a. b.
11.	Are there two permanent, secure vertical grab bars, one at each end of the bathtub, that: a. are mounted 8cm to 12cm in from the outer edge of the bathtub? (NB 3.8.3.17.b(1)(f)(iii)) b. are mounted with the lower end 18cm to 28cm above the bathtub rim? (NB 3.8.3.17(1)(f)(iii)) c. are at least 120cm in length? (NB 3.8.3.17(1)(f)(ii))				a. b. c.
12.	Does the bathtub have a slip-resistant bottom surface? (NB 3.8.3.17(1)(g))				
13.	Is there a slip-resistant bath mat for use outside of the tub if the floor surface is not slip-resistant? (Ability NB Best Practice)				

6.0 ASSEMBLY AREAS	YES	NO	N/A	MEASUREMENTS
1. Does the facility comply with Sections 1-5 of the Accessibility Tool?				
2. Does the signage comply with Section 8.0 of the Accessibility Tool?				
3. Are pews, benches or seats: <ul style="list-style-type: none"> a. stable or fixed? (CSA B651-23, 6.7.2.2(a)) b. at a seat height between 43cm and 48.5cm from the floor or adjustable? (CSA B651-23, 6.7.2.2(b)) c. available in a variety of seating styles (e.g. some with armrests, some without)? (CSA B651-23, 6.7.2.2(c)) 				<ul style="list-style-type: none"> a. b. c.
4. Is there a clear, unobstructed floor area for a wheelchair viewing space that: <ul style="list-style-type: none"> a. is at least 85cm by 139cm? (CSA B651-23, 6.7.3.1(a)) b. is on a clear and level surface? (CSA B651-23, 6.7.3.1(b)) 				<ul style="list-style-type: none"> a. b.
5. Does the number of wheelchair viewing spaces comply with CSA B651-23, 6.7.3.3, Table 9?				

6.0 ASSEMBLY AREAS	YES	NO	N/A	MEASUREMENTS
<p>6. Are wheelchair viewing spaces:</p> <p>a. connected to, but not infringing on, an accessible aisle? (CSA B651-23, 6.7.3.2(a); 6.7.3.4(a))</p> <p>b. integrated into the seating plan of the general public? (CSA B651-23, 6.7.3.2(b))</p> <p>c. dispersed throughout the seating area on all levels? (CSA B651-23, 6.7.3.2(c))</p> <p>d. equipped with a moveable or removeable armrest on the aisle side? (CSA B651-23, 6.7.3.4(b))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
<p>7. Are at least half of all wheelchair viewing spaces side-by-side (e.g. paired)? (CSA B651-23, 6.7.3.2(e))</p>				
<p>8. Do the wheelchair viewing spaces provide lines of sight that are:</p> <p>a. comparable for all viewing positions? (CSA B651-23, 6.7.3.3(a))</p> <p>b. not reduced or obstructed by standing members of the audience? (CSA B651-23, 6.7.3.3(b))</p>				<p>a.</p> <p>b.</p>
<p>9. Is there accent lighting provided along the edges of the aisle steps when overhead lights are dimmed? (DGMA 2.10)</p>				
<p>10. Are the circulation aisles at least 139cm wide? (CSA B651-23, 6.7.3.2, Figure 58)</p>				
<p>11. Is there a marked companion seat available next to the accessible seating? (ADA 221.3)</p>				
<p>12. Is there marked space for a service animal to rest close to the path of travel? (COP – Theatres, Performance Spaces and Lecture Halls)</p>				

6.0 ASSEMBLY AREAS		YES	NO	N/A	MEASUREMENTS
13.	If there are power outlets to allow recharging of batteries for electric mobility aids, are they between 45.5cm and 55cm from the floor? (NB 3.8.3.22.1(f))				
14.	Is there a printed program or digital service plan in plain language provided to attendees? (SFS)				
15.	Is there assistive technology (e.g. assistive hearing devices, closed captioning, ASL interpretation) available? (ADA 216.10)				
16.	Is there an alternative quiet room available with a live video and audio feed with closed captioning? (SFS)				
17.	Is there an accessible route to all areas (e.g. stages, witness stands, podiums) that complies with Section 4.0(15) of the Accessibility Tool ?				
18.	Are podium stands or lecterns height adjustable or have knee clearance that complies with Section 4.1(15) of the Accessibility Tool ? (NCSC - Lecterns)				
19.	If there are microphones, are they height adjustable or wireless? (CK 4.3.5)				
20.	Do stages or elevated platforms have: <ul style="list-style-type: none"> a. a ramp or an accessible route for easy access? (CK 4.3.3) b. a minimum clear floor space of 244cm by 244cm? (CK 4.3.3) c. tactile surface indicators along the edge if they are not protected by a guard or if they are higher than 2.5cm from the ground? (CK 4.3.3) 				<ul style="list-style-type: none"> a. b. c.
21.	Do ticket counter/concession stands comply with Section 4.0(21) of the Accessibility Tool ?				

7.0 RECREATION FACILITIES	YES	NO	N/A	MEASUREMENTS
1. If there is an outdoor ramp, does it comply with Section 12.0 of the Accessibility Tool EXCEPT with a width of at least 107cm between handrails to accommodate multisport wheelchairs? <i>(Ability NB best practice)</i>				
2. Does the entrance comply with Section 1.0 of the Accessibility Tool EXCEPT with a width of at least 107cm , excluding hardware, to accommodate multisport wheelchairs? <i>(Ability NB Best Practice)</i>				
3. Do all interior doorways comply with Sections 4.0(1) to 4.0(15) of the Accessibility Tool EXCEPT with a width of at least 107cm when in the wide-open position to accommodate multisport wheelchairs? <i>(Ability NB Best Practice)</i>				
4. Do the designated accessible washrooms comply with Sections 5.0 to 5.3 of the Accessibility Tool EXCEPT to have at least one stall door with a width of at least 107cm , excluding hardware, to accommodate multisport wheelchairs? <i>(Ability NB Best Practice)</i>				
5. Do universal washrooms comply with Section 5.4 of the Accessibility Tool EXCEPT with a width of at least 107cm , excluding hardware, to accommodate multisport wheelchairs?				
6. Do showers comply with Section 5.5 of the Accessibility Tool ?				
7. Can a wheelchair or power scooter user access all primary areas, levels and amenities within the facility (e.g. pools, gymnasiums, change rooms)? <i>(NB 3.8.2.3)</i>				
8. Is there a clear, unobstructed floor area for a wheelchair viewing space that: a. is at least 85cm by 139cm ? <i>(CSA B651-23, 6.7.3.1(a))</i> b. on a clear and level surface? <i>(CSA B651-23, 6.7.3.1(b))</i>				a. b.

7.0 RECREATION FACILITIES	YES	NO	N/A	MEASUREMENTS
9. Does the number of wheelchair viewing spaces comply with CSA B651-23, 6.7.3.3, Table 9 ?				
10. Are wheelchair viewing spaces: a. connected to, but not infringing on, an accessible aisle? (CSA B651-23, 6.7.3.2(a); 6.7.3.4(a)) b. integrated into the seating plan of the general public? (CSA B651-23, 6.7.3.2(b)) c. dispersed throughout the seating area on all levels? (CSA B651-23, 6.7.3.2(c)) d. equipped with a moveable or removeable armrest on the aisle side? (CSA B651-23, 6.7.3.4(b))				a. b. c. d.
11. Are at least half of all wheelchair viewing spaces side-by-side (e.g. paired)? (CSA B651-23, 6.7.3.2(e))				
12. Do the wheelchair viewing spaces provide lines of sight that are: a. comparable for all viewing positions? (CSA B651-23, 6.7.3.3(a)) b. not reduced or obstructed by standing members of the audience? (CSA B651-23, 6.7.3.3(b))				a. b.
13. Is there an alternative quiet room with a live video and audio feed with closed captioning? (SFS)				
14. Are there lowered storage spaces or lockers that are between 46cm and 122cm from the floor? (TO 2.3.6)				

7.0 RECREATION FACILITIES	YES	NO	N/A	MEASUREMENTS
<p>15. Is there accessibility equipment (e.g. pool wheelchairs, hockey sledges) available on site that:</p> <p>a. is in an identified location that is easy to find? (Ability NB Best Practice)</p> <p>b. can be reserved ahead of time? (Ability NB Best Practice)</p> <p>c. has readily available information online and at the site? (Ability NB Best Practice)</p> <p>d. is well-maintained? (Ability NB Best Practice)</p> <p>e. has staff trained to use it? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
<p>16. Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? (Ability NB Best Practice)</p>				
<p>17. If there are power outlets to allow recharging of batteries for electric mobility aids, are they between 45.5cm and 55cm from the floor? (NB 3.8.3.22.1(f))</p>				

7.0 RECREATION FACILITIES	YES	NO	N/A	MEASUREMENTS
<p>18. Do water fountains/bottle filling stations:</p> <ul style="list-style-type: none"> a. have a location along an accessible route? (NB 3.8.3.10.1(a)) b. have a clear, unobstructed floor area of at least 82cm by 139cm in front of them? (CSA B651-23, 6.1.6(a), Figure 40) c. have knee clearance under the fountain that is at least 82cm wide, 20cm deep and 68.5cm in height? (CSA B651-23, 6.1.6(b), Figure 40) d. have a spout that is between 75cm and 90cm from the floor? (CSA B651-23, 6.1.2(a)) e. operate with controls that are either automatic, located on the front or located on both sides of the fountain? (NB 3.8.3.10(e)(ii)) f. have colour contrast to the wall? (CSA B651-23, 6.1.5) 				a. b. c. d. e. f.
<p>19. If the water fountain/bottle filling station is cantilevered, is it cane-detectable or recessed with a toe space of at least 82cm wide, 23cm deep and 23cm high? (CSA B651-23, 6.1.6(c))</p>				
<p>20. If activities are outdoors, is there a nearby accessible shelter for warming up? (ADANN - Shelters)</p>				
<p>21. Are the accessible washroom facilities provided close to outdoor activities? (Ability NB Best Practice)</p>				
<p>22. Are outdoor activities and amenities connected to the facility by unobstructed, level pathways of at least 150cm in width? (NB 3.8.3.3(a))</p>				

7.1 CHANGE ROOMS AND LOCKER ROOMS	YES	NO	N/A	MEASUREMENTS
1. Is the floor of the change/locker room: a. well-drained to prevent water from pooling? (SPDOS 2.1.12.6) b. slip-resistant? (SPDOS 2.1.12.5) c. colour contrasted from the walls, benches and lockers? (COP – Colour and Brightness Contrast)				a. b. c.
2. If outdoors, does the change/locker room have an entrance that complies with Section 1.0 of the Accessibility Tool ?				
3. If indoors, does the change/locker room have interior doors that comply with Section 4.0(1) to 4.0(15) of the Accessibility Tool ?				
4. Is there signage in the change/locker rooms leading to the main area that complies with Section 8.0 of the Accessibility Tool ?				
5. Is the room well-illuminated to at least 215 lux ? (SPDOS 2.1.9)				
6. Are the clothing hooks mounted at a maximum height of 120cm ? (NB 3.8.3.11(g))				

7.1 CHANGE ROOMS AND LOCKER ROOMS	YES	NO	N/A	MEASUREMENTS
<p>7. Do storage lockers:</p> <ul style="list-style-type: none"> a. have a clear, unobstructed aisle space of at least 137cm deep in front of them? (TO 2.3.6) b. have a bottom shelf located between 46cm and 122cm from the floor? (TO 2.3.6) c. have locks located between 91.5cm to 106.5cm? (TO 2.3.6) d. have locks that are easy to operate with limited dexterity? (TO 2.3.6) e. have names or numbers mounted no higher than 152.5cm and lettering that complies with Section 8.0 of the Accessibility Tool? (TO 2.3.6) 				<ul style="list-style-type: none"> a. b. c. d. e.
<p>8. Does the change/locker room have an accessible changing stall with:</p> <ul style="list-style-type: none"> a. the <i>International Symbol of Access</i>? (CSA B651-23, 6.3.1.1(d)(ii)) b. signage which complies with Section 8.0 of the Accessibility Tool? 				<ul style="list-style-type: none"> a. b.

7.1 CHANGE ROOMS AND LOCKER ROOMS	YES	NO	N/A	MEASUREMENTS
9. Do accessible changing stalls: <ul style="list-style-type: none"> a. have a minimum of 210cm by 210cm clear floor area? (CSA B651-23, 6.8.2) b. have a bench which is at least 76cm wide by 183cm long by 48cm to 52cm high? (CSA B651-23, 6.4.1)? c. have hooks that are on the wall that are not more than 120cm from the floor and projects not more than 4cm from the wall? (CSA B651-23, 6.8.1(c)) d. have a full-length mirror? (CSA B651-23, 6.8.1(d)) e. have grab bars? (CSA B651-23, 6.8.1(e)) f. have an emergency call system? (CSA B651-23, 6.8.1(b)) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
10. Do washrooms comply with Sections 5.0 to 5.4 of the Accessibility Tool?				
11. Do showers comply with Section 5.5 of the Accessibility Tool?				

7.1 CHANGE ROOMS AND LOCKER ROOMS	YES	NO	N/A	MEASUREMENTS
<p>12. When considering a sensory friendly environment:</p> <p>a. Is there limited background noise? (SFS)</p> <p>b. Is there sensory friendly ear protection provided? (SFS)</p> <p>c. Are all rooms and paths of travel well-illuminated without exceeding 500 lux except where there is natural light available? (COP – Lighting)</p> <p>d. If the building is lit with fluorescent lighting, are there blue light glasses available? (SFS)</p> <p>e. Is there comfortable seating provided in a quiet area? (SFS)</p> <p>f. Is the environment scent-free? (SFS)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>

71 CHANGE ROOMS AND LOCKER ROOMS	YES	NO	N/A	MEASUREMENTS
<p>13. Are baby changing tables:</p> <ul style="list-style-type: none"> a. mounted with its top no higher than 86cm from the floor?(CSA B651-23, 6.2.3.1(b)) b. mounted with a knee clearance of at least 68.5cm high? (CSA B651-23, 6.2.3.1(c)) c. no deeper than 60cm from the front of the table to the wall? (CSA B651-23, Annex A.2.2) d. within a reach of no more than 50cm from a seated position? (CSA B651-23, Annex A.2.2) e. mounted without impeding paths of travel or transfer spaces? (ADA 604.8.1.1) f. colour contrasted from the wall? (COP – Washrooms and Shower Stalls) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>14. Are baby-changing tables mounted with its center no higher than 86.5cm from the floor level? (TADG 2.3.11)</p>				

7.2 HOCKEY ARENAS		YES	NO	N/A	MEASUREMENTS
1.	Does the arena comply with Section 7.0 of the Accessibility Tool?				
2.	Do the player/penalty areas have two doors that are at least 91cm wide when open? (CFRC 2.1)				
3.	Are the player/penalty areas a minimum of 182.9cm wide? (CFRC 2)				
4.	Do player/penalty areas have removeable benches to allow for sledges? (CFRC 2.1)				
5.	Is there a minimum of 90cm between the bench and boards? (CFRC 2.1)				
6.	Do the player/penalty areas have a clear, level surface? (CFRC 2.1)				
7.	Do the player/penalty areas have an artificial ice or ice surface to allow the sledges to glide and avoid damage while entering/exiting the player/penalty areas? (CFRC 2.1,2.2)				
8.	Are any structural supports padded or protected to avoid damage or injury of the players? (CFRC 2.1)				
9.	Is there clear and unobstructed plexiglass installed at the front of the player/penalty areas to allow for viewing by the players? (CFRC 2.1)				
10.	Is the dasher board door or gate no less than 90cm wide? (CFRC 2)				
11.	Is there a threshold of no more than 1.9cm between the dasher boards and the ice surface? (CFRC 2)				
12.	Do change rooms/locker rooms comply with Section 7.1 of the Accessibility Tool?				
13.	Are the sledge hockey change rooms close to the ice surface? (CFRC 2.4)				
14.	Is there an artificial ice surface to allow sledges to glide to the playing area from the change/locker room? (CFRC 2.4)				

7.3 INDOOR POOL FACILITIES	YES	NO	N/A	MEASUREMENTS
1. Does the facility comply with Section 7.0 of the Accessibility Tool?				
2. Is the pool connected to amenities (e.g. accessible washrooms, change rooms, canteens) by clear, unobstructed accessible paths of at least 150cm wide? (NB 3.8.3.3(a))				
3. Does the pool have a gallery/viewing area that: <ul style="list-style-type: none"> <li data-bbox="170 451 1045 521">a. complies with Section 7.0(7-10) of the Accessibility Tool? <li data-bbox="170 548 1045 618">b. has a direct unobstructed accessible path of travel from the pool area? (SPDOS 2.1.16) <li data-bbox="170 646 1045 716">c. has wayfinding signage that complies with Section 8.0 of the Accessibility Tool? 				<ul style="list-style-type: none"> <li data-bbox="1388 451 1409 483">a. <li data-bbox="1388 548 1409 581">b. <li data-bbox="1388 646 1409 678">c.
4. If the gallery/viewing area hangs over the deck, is there at least 250cm in height between the pool and deck? (SPDOS 2.1.16.2)				
5. Are amenities (e.g. water fountains, change rooms) located away from the deep end of the pool? (SK 2.1.10); (SPDOS 2.1.12.13(b))				
6. Do change rooms comply with Section 7.1 of the Accessibility Tool?				
7. Does all signage comply with Section 8.0 of the Accessibility Tool?				

7.3 INDOOR POOL FACILITIES	YES	NO	N/A	MEASUREMENTS
<p>8. When considering a sensory friendly environment:</p> <p>a. Is there limited background noise? (SFS)</p> <p>b. Is there sensory friendly ear protection provided? (SFS)</p> <p>c. Are all rooms and paths of travel well-illuminated without exceeding 500 lux except where there is natural light available? (COP – Lighting)</p> <p>d. If the building is lit with fluorescent lighting, are there blue light glasses available? (SFS)</p> <p>e. Is there comfortable seating provided in a quiet area? (SFS)</p> <p>f. Is the environment scent-free? (SFS)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>

7.3.1 INDOOR POOL DECKS		YES	NO	N/A	MEASUREMENTS
1.	Is the deck surface slip-resistant and non-abrasive? (SPDOS 2.1.8 (7))				
2.	Are skimmers, gutters, etc., covered with plastic or metal grating that is flush with the pool surface? (SC 2.4.3)				
3.	Is the deck leading to the accessible shallow entrance of the pool: <ul style="list-style-type: none"> a. colour contrasted from the pool edge and the walls? (COP - Colour and Brightness Contrast) b. identified by tactile walking surface indicators? (COP - Attention TWSI) c. identified with acoustic signals? (COP - Acoustics) 				a. b. c.
4.	Does the deck area surround the entire pool and is not less than 180cm wide with not less than 90cm width behind pool components (e.g. diving boards, slides)? (SPDOS 2.1.8)				
5.	Does the deck area have tactile walking surface indicators indicating the perimeter of the pool? (COP - Attention TWSI)				
6.	Does the deck have wayfinding signage to indicate accessible entrances to the change rooms that complies with Section 8.0 of the Accessibility Tool ?				

7.3.2 INDOOR SWIMMING POOLS	YES	NO	N/A	MEASUREMENTS
<p>1. Does ramped entry to the pool have:</p> <p>a. a maximum slope of 1:12 (8.3%)? (NB 3.8.3.5(1)(b))</p> <p>b. handrails on both sides between 86cm to 92cm from the ramp surface to the top of the rail? (CSA B651-23, 5.5.8(a)(ii))</p> <p>c. a slip-resistant, non-abrasive surface? (NB 3.8.3.5(4))</p> <p>d. a width of at least 92cm to 100cm wide between rails? (CSA B651-23, 5.5.8(b))</p> <p>e. a water depth at the bottom of the pool not exceeding 76cm? (ADA 1009.3.2)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
<p>2. Does the stepped platform into the pool have:</p> <p>a. a slip-resistant, non-abrasive surface? (SPDOS 2.1.7)</p> <p>b. a transfer area at the top which is at least 60cm by 60cm and is located 45cm from the surface of the water? (SPDOS 2.1.7)</p> <p>c. steps which measure 15cm high, 60cm wide and 45cm deep? (SPDOS 2.1.7)</p> <p>d. steps which lead below the surface of the water not more than 30cm deep? (SPDOS 2.1.7)</p> <p>e. a continuous handrail on both sides of the steps and along the back of the transfer area which is at a height between 30cm to 40cm? (SPDOS 2.1.7)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>

7.3.2 INDOOR SWIMMING POOLS	YES	NO	N/A	MEASUREMENTS
3. If the pool has underwater lighting, are the lights: <ul style="list-style-type: none"> a. shielded? (SPDOS 2.1.9) b. shatter-proof? (SPDOS 2.1.9) c. glare-free? (SPDOS 2.1.9) 				<ul style="list-style-type: none"> a. b. c.
4. Is the swimming pool free of current or turbulence? (SC 2.12)				
5. Is the water temperature of the swimming pool no more than 30 C (86 F) ? (SPDOS 3.1.13)				
6. Are the depth markers: <ul style="list-style-type: none"> a. on both sides of the pool that indicate minimal and maximum depths and where there is are level changes? (SPDOS 2.2.5) b. colour contrasted from the deck and pool? (SPDOS 2.3.3) c. at least 10cm in height? (SPDOS 2.3.3) d. at least 46cm from the water surface? (SPDOS 2.3.3) e. identified with tactile indicators (COP - Tactile Signs) 				<ul style="list-style-type: none"> a. b. c. d. e.

7.3.2 INDOOR SWIMMING POOLS	YES	NO	N/A	MEASUREMENTS
<p>7. Are lane markings:</p> <ul style="list-style-type: none"> a. placed on the floor of the pool in the center of each lane?(SC 2.14) b. dark and colour contrasted from the pool floor? (SC 2.14) c. a width of between 20cm and 30cm? (SC 2.14) 				<ul style="list-style-type: none"> a. b. c.
<p>8. If the pool has a bulkhead, does it:</p> <ul style="list-style-type: none"> a. extend to the full width of the swimming pool? (SC 2.15) b. have a solid, level, slip-resistant, non-abrasive surface? (SC 2.15) c. contrast in colour from the walls, deck and ceiling? (SC 2.15) d. have touch pads mounted not less than 80cm below and 30cm above the surface of the water? (SC 2.15) e. have gutters covered by a screen or grill? (SC 2.15) f. have no openings or sharp edges that could lead to bodily injuries? (SC 2.15) g. attach securely to the surface so as not to create any water turbulence or current while someone is walking/standing on it? (SC 2.15) 				<ul style="list-style-type: none"> a. b. c. d. e. f. g.

8.0 WAYFINDING AND SIGNAGE	YES	NO	N/A	MEASUREMENTS
1. Are there tactile signs with raised print, raised symbols or braille within the facility? (COP - Tactile Signs)				
2. Is the raised/tactile print: a. raised between 0.08cm and 0.15cm above the surface? (CSA B651-23, 4.6.6.2(a)) b. 1.6cm to 5cm in height? (CSA B651-23, 4.6.6.2(b)) c. supplemented with braille near the bottom edge of the sign? (CSA B651-23, 4.6.6.2(d))				a. b. c.
3. Are pictograms, graphics or symbols: a. raised between 0.08cm and 0.15cm above the surface? (CSA B651-23, 4.6.6.3(a)) b. at least 15cm in height? (CSA B651-23, 4.6.6.3(b)) c. supplemented with print and braille near the bottom edge of the sign? (Ability NB Best Practice) d. colour contrasted with their background? (CSA B651-23, 4.6.6.3(c))				a. b. c. d.
4. Is there at least 14-point font? (CNIB: Clear Print Accessibility Guidelines)				
5. Is the font composed of Arabic numerals and sans serif fonts (ex. Ad Sans, Arial, Calibri)? (CSA B651-23, 4.6.3(a)(b))				
6. Does the character height to viewing distance (e.g. on restaurant menu boards) meet requirements seen in CSA B651-23, Table 7 ?				

8.0 WAYFINDING AND SIGNAGE	YES	NO	N/A	MEASUREMENTS
7. Are electronic signs illuminated to at least 200 lux ? (CSA B651-23, 4.6.5)				
8. Does the colour contrast on the signage meet the requirements found in the table on Clearing our Path's Colour Contrast on Signs ?				
9. Is the <i>International Symbol of Access</i> present to indicate accessible features? (CSA B651-23, 4.6.7)				
10. Is signage composed of a clear, concise and clutter-free design with plain language? (SFS)				
11. Does signage information have short and simple language that is easy to understand? (COP - Signage)				
12. Does signage have clear literal symbols or graphics associated with the location the signage is describing? (ASNB)				

8.0 WAYFINDING AND SIGNAGE	YES	NO	N/A	MEASUREMENTS
<p>13. Are the tactile signs mounted:</p> <p>a. on the wall beside the latch edge of the door, if being used to identify the door? (CSA B651-23, 4.6.6.4(a))</p> <p>b. 140cm to 160cm from the door jamb? (CSA B651-23, 4.6.6.4(b))</p> <p>c. on the nearest adjacent wall where double-leaf doors are used or no wall space adjoins the door latch edge? (CSA B651-23, 4.6.6.4(c))</p> <p>d. where it allows a person to approach the sign within 10cm without encountering protruding objects or standing within a door swing? (CSA B651-23, 4.6.6.4(d))</p> <p>e. with the centerline 125cm to 175cm from the floor? (CSA B651-23, 4.6.6.4(e))</p> <p>f. mounted with a clear wall area around the sign at least 7.5cm wide? (CSA B651-23, 4.6.6.4(f))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>
<p>14. Is the signage positioned to avoid shadow areas and does it have a glare-free surface? (CSA B651-23, 4.6.2(a))</p>				
<p>15. Are there audio signs that are automatic or can be manually activated when needed? (COP – Audible Signs)</p>				
<p>16. Is the building name and address clearly visible from the exterior of the building? (COP – Building Entrances)</p>				
<p>17. Is there wayfinding signage along the path of travel to the entrance of a larger building? (COP – Building Entrances)</p>				

9.0 EMERGENCY AND EVACUATION	YES	NO	N/A	MEASUREMENTS
1. Is there an evacuation plan: a. for the building? (CSA B651-23, 5.7.3) b. for when the elevator does not operate (e.g. an available evacuation chair)? (CSA B44:19, 2.27)				a. b.
2. Is the evacuation plan: a. mounted with the horizontal centerline 150cm from the floor? (CSA B651-23, 5.7.3(a)) b. available in alternative formats (e.g. print, digital)?(CSA B651-23, 5.7.3(c)) c. on signage that complies with Section 8.0 of the Accessibility Tool? d. posted in every room or level? (GEPP, page 4)				a. b. c. d.
3. Are fire drills regularly scheduled? (COP - Emergency Exits)				
4. Are there at least 2 emergency exits per floor? (NBC 3.4.2.1)				
5. Do the emergency exit doors have a width of at least 86cm wide when in the open wide position? (CSA B651-23, 5.2.1(a))				
6. Do the emergency exit doors have signage that complies with Section 8.0 of the Accessibility Tool?				

9.0 EMERGENCY AND EVACUATION	YES	NO	N/A	MEASUREMENTS
<p>7. Are the emergency hallways or corridors:</p> <ul style="list-style-type: none"> a. at least 180cm wide? (COP - Corridors and Hallways) b. clearly identified as accessible evacuation routes on the evacuation plan? (CSA B651-23, 5.7.2.2.2) c. equipped with wayfinding signage to identify the emergency hallways or corridors? (CSA B651-23, 5.7.2.2.2) 				<ul style="list-style-type: none"> a. b. c.
<p>8. Is there a designated area of safe refuge in the building that:</p> <ul style="list-style-type: none"> a. has a clear, unobstructed floor space of at least 90cm by 139cm? (CSA B651-23, 5.7.2.1(c)) b. has a hands-free communication system mounted not higher than 120cm from the floor? (CSA B651-23, 5.7.2(d)(i)) c. is in a location directly by an exit or by a firefighter's elevator? (CSA B651-23, 5.7.2(g)) d. has wayfinding signage to indicate the location of the area of refuge? (CSA B651-23, 5.7.2.2.1(a)) e. is clearly identified on the posted evacuation plan? (CSA B651-23, 5.7.2.2.1(d)) 				<ul style="list-style-type: none"> a. b. c. d. e.
<p>9. Is there emergency lighting to identify exit doors, egress routes and areas of refuge in the event of a power outage? (COP - Emergency Lighting)</p>				

9.0 EMERGENCY AND EVACUATION		YES	NO	N/A	MEASUREMENTS
10.	Do the elevator call buttons have: <ul style="list-style-type: none"> a. a two-way communication system? (CSA B44:19, E-11.1) b. clear identification, such as PHONE or EMERGENCY STOP, with raised print and braille? (CSA B44:19, E-9.3.3.1) c. a height of at least 89cm from the floor? (CSA B44:19, E-9.2) d. sound patterns that are distinctly different from the other alert signals in the building? (NBC 3.2.4.19 (3)) 				a. b. c. d.
11.	Does the universal washroom have an emergency call system? (CSA B651-23, 6.3.1.2)				
12.	Is the universal washroom door able to be unlocked from the outside in an emergency situation? (NBC 3.8.3.12 (b))				
13.	Are there fire extinguishers mounted at no more than 120cm from the floor? (CSA B651-23, 4.3.3, Figure 3)				
14.	Are all staff trained on procedures in the event of an emergency? (OHS 17.6(1)(b))				

FOR OPERATIONAL GUIDANCE ONLY

EXTERIOR SPACES

10.0 PARKING	YES	NO	N/A	MEASUREMENTS
1. Does your business/facility offer customer parking? If "yes", proceed to next question. If "no", proceed to next section.				
2. Does the parking have a firm, slip-resistant and level surface constructed of asphalt, concrete or well-compacted, well-drained crusher dust? (NB 3.8.3.4(3)(b))				
3. How many designated accessible parking spaces does the location have? _____ out of _____ total parking spaces?				
4. Does the number of designated parking spaces comply with Table 3.8.2.5 in the Barrier-Free Design Building Code NB Reg 2021-3 ?				
5. Are the designated parking spaces at least 260cm wide and 750cm long? (NB 3.8.3.4.3(a))				
6. Is there an access aisle not less than 200cm wide and 750cm long, adjacent and parallel to the vehicle pull up space? (NB 3.8.3.4(3)(a))				
7. Do the designated parking spaces have the <i>International Symbol of Access</i> painted on the surface? (NB 3.8.3.4.3(e))				
8. Do the designated parking spaces have a vertically mounted sign with the <i>International Symbol of Access</i> with the center between 150cm and 200cm from the ground? (NB 3.8.3.4.3(e))				
9. Do the designated accessible parking spaces have tactile walking surface indicators (TWSI) to indicate the perimeter of the parking space? (COP - Tactile Walking Surface Indicators)				
10. Is there wayfinding signage from parking to entrance that complies with Section 8.0 of the Accessibility Tool ?				
11. Are the designated parking spaces located close to the entrance, curb ramp or crosswalk? (Ability NB Best Practice)				

10.0 PARKING		YES	NO	N/A	MEASUREMENTS
12.	Do curb ramps have: <ul style="list-style-type: none"> a. a firm, level and slip-resistant surface? (CSA B651-23, 8.3.3.4.1(a)) b. a running slope of between 1:15 (6.7%) and 1:10 (10%)? (CSA B651-23, 8.3.3.1(a)) c. a cross slope not more than 1:50 (2%)? (CSA B651-23, 8.3.3.2(b)) d. tactile indicators that extend the full width of the ramp and begin 30cm to 35cm from the edge of the road? (CSA B651-23, 8.3.3.4.1(c)) e. have a width of at least 150cm? (CSA B651-23, 8.3.3.5) f. have no catch basin covers or gratings within the path of travel? (CSA B651-23, 8.3.3.7(b)) g. a clear, level area of at least 139cm by 139cm at the top of the ramp? (CSA B651-23, 8.3.3.8) 				a. b. c. d. e. f. g.
13.	Are the designated parking spaces located within 5000cm of the accessible entrance and easy to locate from the main route? (NB 3.8.3.4.3(c))				
14.	Do passenger pick up/drop off zones: <ul style="list-style-type: none"> a. provide a curb ramp where there are curbs between the access aisle and the vehicle pull-up space? (NB 3.8.3.4 (1)(b)) b. have an access aisle that is at least 150cm wide and 700cm long, adjacent and parallel to the vehicle pull-up space? (CSA B651-23, 9.3.1(b)) c. have a clear height of no less than 300cm? (CSA B651-23, 9.3.2(a)) 				a. b. c.

10.0 PARKING		YES	NO	N/A	MEASUREMENTS
15.	Do designated accessible street parking spaces have a clear pick up/drop off area on the curb side of the street that: <ul style="list-style-type: none"> a. is clear, firm and level? (CSA B651-23, 9.4.1, Figure 68) b. is at least 200cm wide by 550cm long? (CSA B651-23, 9.4.1, Figure 68) c. is adjacent and parallel to the parking space? (CSA B651-23, 9.4.1, Figure 68) 				a. b. c.
16.	Is there a height clearance of at least 300cm at the pull-up space and along the vehicle access routes (e.g. in parking garages, under awnings)? (CSA B651-23, 9.3.2(a))				
17.	In the winter, are the designated spaces clear of snow and well-salted or well-sanded? (TO 1.6.11)				
18.	Are the accessible parking spaces well-illuminated at all times of the day? (COP - Lighting)				
19.	If there are parking meters, do they: <ul style="list-style-type: none"> a. have a location connected to an unobstructed, accessible path of travel? (CSA B651-23, 8.6.10(a)) b. have a clear approach ground space of at least 82cm by 139cm? (CSA B651-23, 8.6.10(a)) c. have operating mechanisms between 90cm to 120cm from the ground? (CSA B651-23, 8.6.10(e)(i)) d. have signage that complies with Section 8.0 of the Accessibility Review Tool? e. have colour contrast to their surroundings? (CSA B651-23, 8.6.10(g)) 				a. b. c. d. e.

10.0 PARKING	YES	NO	N/A	MEASUREMENTS
<p>20. Are ticket or payment machines:</p> <ul style="list-style-type: none"> a. installed with the centerline of operating controls on ticket or payment machines located between 40cm and 120cm from the ground surface? (NB 3.8.3.8.1(a)) b. located adjacent to a vehicular route? (CSA B651-23, 9.6) c. unobstructed by a curb or other barrier (e.g. snow banks)? (CSA B651-23, 9.6) d. installed with a front approach at least 80cm wide? (CSA B651.2:22, 9.1.2(a)) e. equipped with a swipe card reader that is able to read a card swiped in either direction? (CSA B651.2:22, 10.5.5) 				<ul style="list-style-type: none"> a. b. c. d. e.
<p>21. If ticket or payment machines are equipped with a keypad:</p> <ul style="list-style-type: none"> a. is the keypad telephone style with the number "1" at the top left? (CSA B651.2:22, 10.7.2.1(a)) b. are the keys a minimum of 1.5cm wide? (CSA B651.2:22, 10.7.2.2(a)) c. does the keypad have a matte surface to minimize glare?(CSA B651.2:22, 10.7.2.1(f)) d. is it placed at an angle between 10 and 45 degrees? (CSA B651.2:22, 10.7.2.1(e)) e. does it have colour contrasted characters or numbers from the keys? (CSA B651.2:22, 10.7.2.3(a)) f. are there tactile graphics on the keys? (CSA B651.2:22, 10.7.2.2(c)) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
<p>22. If there is a service booth, do payment terminals have a cord at least 100cm long so it can be passed easily to the driver?(CSA B651-23, 6.6.2.3)</p>				

11.0 ROUTES FROM PARKING TO ENTRANCE	YES	NO	N/A	MEASUREMENTS
1. Does the path of travel have a width of at least 160cm ? (CSA B651-23, 8.2.2(a))				
2. Are there any tactile walking surface indicators to indicate the path of travel to the accessible entrance? (COP - Tactile Walking Surface Indicators)				
3. If traffic must be crossed, is there a designated crosswalk for safe pedestrian crossing? (CSA B651-23, 8.3)				
4. Is the crosswalk connected to an unobstructed, accessible path of travel by either: a. a grade level crossing (CSA B651-23, 8.3.2.1) or b. a raised crossing? (CSA B651-23, 8.3.2.2)				a. b.
5. Does the crosswalk have: a. contrasting colours? (COP - Colour and Brightness Contrast) b. tactile walking surface indicators? (CSA B651-23, 8.3.4.1(d)(iv)) c. acoustic locator signals? (COP - Accessible Pedestrian Signals) d. vibro-tactile signal buttons? (COP - Accessible Pedestrian Signals)				a. b. c. d.
6. Are all the curbs along the route cut where the sidewalk is not ground level? (NB- 3.8.3.4(b))				
7. Is the path of travel to the ramp or the door safe and clear of obstructions (e.g. steps, abrupt changes in level, hills, pot holes, sandwich board signs, garbage cans)? (NB 3.8.3.2.1)				

11.0 ROUTES FROM PARKING TO ENTRANCE		YES	NO	N/A	MEASUREMENTS
8.	If there are gratings on the path of travel, are the openings less than 1.3cm wide in both directions? (NB 3.8.3.6.5)				
9.	Is the surface of the route firm and slip-resistant, direct and level? (NB 3.8.3.2.2(c))				
10.	Is the route well-drained to prevent accumulation of water, snow and ice and well-salted or well-sanded? (GCAF – Sidewalks, Pathways and Trails)				
11.	Is the entrance located 5000cm from transit stops? (WHO)				
12.	Do transit shelters have: <ul style="list-style-type: none"> a. clear, level access to the accessible route? (CSA B651-23, 8.5.4(a)) b. a clear floor area of at least 210cm by 210cm inside the entry? (CSA B651-23, 8.5.4(e)) c. a clear opening of at least 100cm wide where there is no door? (CSA B651-23, 8.5.4(f)) 				<ul style="list-style-type: none"> a. b. c.
13.	Is the route well-illuminated from the parking area to the accessible entrance? (COP - Lighting)				

12.0 OUTDOOR RAMPS		YES	NO	N/A	MEASUREMENTS
1.	Does the ramp have a slip-resistant surface, even when wet? (NB 3.8.3.5(4))				
2.	If the ramp surface is constructed of steel grating, are the openings no more than 1.3cm wide? (CSA B651-23, 4.4.4(a))				
3.	Are exterior ramps well-drained to prevent accumulation of water, snow and ice and are well-salted or well-sanded? (GCAF – Sidewalks, Pathways and Trails)				
4.	Does the ramp have: <ul style="list-style-type: none"> a. a running slope of no more than 1:20 (5%)? (CSA B651-23, 8.2.7(a)) b. a cross slope of no more than 1:50 (2%)? (CSA B651-23, 8.2.7(b)) c. no more than 900cm between landings or intervals?(CSA B651-23, 5.5.1(b)) d. a surface width of at least 120cm? (CSA B651-23, 8.2.7(c)) 				<ul style="list-style-type: none"> a. b. c. d.
5.	Is there an unobstructed, firm and level area of : <ul style="list-style-type: none"> a. 210cm by 210cm at the top of the ramp where the door swings outward or 170cm by 170cm where door swings inward? (CSA B651-23, 5.5.4(a)) b. 170cm by 170cm at ramp intervals? (CSA B651-23, 5.5.4(b)) c. 170cm by 170cm at the bottom of the ramp? (CSA B651-23, 5.5.4(a)) 				<ul style="list-style-type: none"> a. b. c.

12.0 OUTDOOR RAMPS	YES	NO	N/A	MEASUREMENTS
<p>6. At the top landing, is there either:</p> <p>a. at least 60cm beyond the edge of the door opening when the door opens towards the ramp? (NB 3.8.3.5 1(c)(i)(ii))</p> <p>b. at least 30cm beyond the edge of the door where the door opens away from the ramp? (NB 3.8.3.5 1(c)(i)(ii))</p>				<p>a.</p> <p>b.</p>
<p>7. Are the handrails:</p> <p>a. on both sides of the ramp and continuous around landings? (CSA B651-23, 5.5.8(a)(iii))</p> <p>b. colour contrasted to the surroundings? (CSA B651-23, 5.5.8(a)(iv))</p> <p>c. 92cm to 100cm wide between rails? (CSA B651-23, 5.5.8(b))</p> <p>d. at a height of 86cm to 92cm from the ramp surface to the top of the rail? (CSA B651-23, 5.5.8(a)(ii))</p> <p>e. extended horizontally at least 30cm beyond the top and bottom of the ramp and return to the post, floor or wall? (CSA B651-23, 5.5.8(c))</p> <p>f. constructed of a material that does not absorb heat? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>
<p>8. If the ramp is wider than 150cm, is there an intermediate rail? (NBC 3.4.6.6(2))</p>				
<p>9. Where the ramp or landing is not at grade, is there one of the following:</p> <p>a. edge protection on both sides of at least 10cm high? (CSA B651-23, 5.5.7(a))</p> <p>b. a railing with its lower edge not more than 10cm from the surface? (CSA B651-23, 5.5.7(b))</p>				<p>a.</p> <p>b.</p>

12.0 OUTDOOR RAMPS		YES	NO	N/A	MEASUREMENTS
10.	Is there a threshold of no more than 1.3cm high or is it beveled at a slope of 1:2 (50%) where over 0.6cm high? (CHPC 3.3.4)? (CHPC 3.3.4)				
11.	Does the ramp have tactile attention walking surface indicators at the beginning and end of the ramp? (COP - Attention TWSI)				
12.	Is the ramp well-illuminated, at a minimum of 200 lux , avoiding shadows or glare? (COP - Lighting)				

13.0 TRAILS		YES	NO	N/A	MEASUREMENTS
1.	Does the parking at the trailhead comply with Section 10.0 of the Accessibility Tool ?				
2.	Is the trail made from a well-maintained accessible surface, like wood decking or well-compacted and well-drained crusher dust? (CHPC 3.2.1)				
3.	Does the trail have a minimum width of 150cm to allow two wheelchairs to pass? (CHPC 3.3.1)				
4.	Does the trail provide passing spaces: <ul style="list-style-type: none"> a. with a minimum width of 183cm? (CSA B651-23, Annex D.5(d)) b. at intervals of between 4500 to 12000cm apart depending on level of challenge? (CHPC 3.3.1) 				a. b.
5.	Do all paths of travel on and off the trail: <ul style="list-style-type: none"> a. have a width of at least 150cm? (CHPC 3.3.1) b. have a running slope not greater than 1:20 (5%)? (CHPC 3.3.2) c. have a cross slope not greater than 1:50 (2%)? (CHPC 3.3.2) d. have a threshold of no more than 1.3cm high or be beveled at a slope of 1:2 (50%) where over 0.6cm high?(CHPC 3.3.4) 				a. b. c. d.
6.	Are the shoulders of the accessible trail cleared to a minimum of 50cm from the edge? (CHPC 4.2.4)				
7.	Is the trail free from obstructions that reduce the clear width, such as rocks, freestanding objects or holes? (CHPC 3.3.5)				
8.	Is there at least 250cm of clear headroom from overhanging obstructions such as low tree branches or overhead signage? (CHPC 3.3.6)				

13.0 TRAILS		YES	NO	N/A	MEASUREMENTS
9.	Is the trail edge well-defined with visual contrasts and textures that are cane detectable, with consistent surfacing? (MPADG page 32)				
10.	If there is a vertical drop from the trail that is larger than 7.5cm , is there a high curb or edge that is at least 7.5cm ? (MPADG page 32)				
11.	If there is a vertical drop that exceeds 60cm , is there a guardrail that is at least 107cm high? (CHPC 4.2.5)				
12.	Do any ramps along the trail comply with Section 12.0 of the Accessibility Tool ?				
13.	Are there rest areas along the trail that: <ul style="list-style-type: none"> a. have seating every 4500cm to 6000cm along the trail? (CHPC 4.2.3) b. are set back from the trail at least 60cm? (CHPC 4.2.3) c. have shelter from the elements? (CHPC 4.2.3) d. have water available for service animals? (Ability NB Best Practice) 				<ul style="list-style-type: none"> a. b. c. d.

13.0 TRAILS		YES	NO	N/A	MEASUREMENTS
14.	<p>Is there signage that complies with Section 8.0 of the Accessibility Tool located:</p> <p>a. at the starting point of the trail? (MPADG P.23, Trail Signs)</p> <p>b. at key intersections or direction changes? (MPADG P.23, Trail Signs)</p> <p>c. at regular intervals to indicate distances to points of interest? (MPADG P.23, Trail Signs)</p> <p>d. where there are changes in trail conditions (e.g. changes in elevation, surface hazards)? (MPADG P.23, Trail Signs)</p> <p>e. where the trail crosses with a vehicular roadway? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
15.	<p>Are interpretive or information boards:</p> <p>a. positioned where they can be viewed from both standing and sitting? (DGMA 6.20)</p> <p>b. located 100cm to 127.5cm above the ground? (DGMA 6.20)</p> <p>c. not obstructed by such things as handrails or overhanging branches? (DGMA 6.20)</p> <p>d. connected to the main trail with an accessible surface? (DGMA 6.20)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
16.	<p>Where trails are near buildings, parking lots or campgrounds, is there adequate lighting provided? (CGOL 4.4)</p>				

13.1 OBSERVATION PLATFORMS	YES	NO	N/A	MEASUREMENTS
1. Does the accessible viewing area have a minimum diameter of 150cm wide or a T-shaped space that is at least 91cm wide and 150cm long at each end to provide space for a wheelchair to turn around or backout? (CSP 44.B)				
2. Does the accessible viewing area have an unobstructed section (e.g. plexiglass window) between 81cm and 129.5cm high except where a safety barrier is necessary? (CSP 44.D)				
3. Does the platform: <ul style="list-style-type: none"> a. have a firm, stable and level surface? (CSP 44.C) b. have no more than a 1:50 (2%) slope in any direction? (CSP 44.C) c. have no more than a 1:20 (5%) slope where necessary for proper drainage if made of asphalt, concrete or wooden boards? (CSP 44.C) 				a. b. c.
4. Do guardrails: <ul style="list-style-type: none"> a. have a height of at least 107cm? (BC page 29) b. have horizontal rails that are equally spaced no more than 46cm apart? (BC page 29) c. have handrails that comply with Section 12.0(7) of the Accessibility Tool? d. have vertical rails that are spaced no more than 10cm apart? (BC page 29) 				a. b. c. d.
5. Is there an unobstructed pathway of at least 92cm wide to all areas of the platform? (CHPC 4.4.3)				
6. Is there at least 250cm of clear headroom from overhanging obstructions such as low tree branches? (CHPC 3.3.6)				

13.1 OBSERVATION PLATFORMS	YES	NO	N/A	MEASUREMENTS
<p>7. Do viewing scopes have:</p> <ul style="list-style-type: none"> a. a clear space of at least 75cm wide and 120cm long in front of them? (CHPC 5.1.11) b. a knee clearance of at least 43cm deep and 68cm high? (CSP 44 (c)) c. an optical lens between 110cm to 130cm from the ground? (CHPC 5.1.11) 				<ul style="list-style-type: none"> a. b. c.
<p>8. Are there rest areas with benches that comply with Section 19.0(1) of the Accessibility Tool?</p>				
<p>9. Is there shelter from the elements available? (UBG 3.1.3)</p>				
<p>10. Are interpretive or information boards:</p> <ul style="list-style-type: none"> a. positioned where they can be viewed from both standing and sitting? (DGMA 6.20) b. located 100cm to 127.5cm above the ground? (DGMA 6.20) c. not obstructed by such things as handrails or overhanging branches? d. connected to the main trail with an accessible surface? (DGMA 6.20) 				<ul style="list-style-type: none"> a. b. c. d.

13.2 BOARDWALKS AND BRIDGES		YES	NO	N/A	MEASUREMENTS
1.	Does the boardwalk have a minimum width of 152cm to allow two wheelchairs to pass? (MP page 9)				
2.	Does the boardwalk have: <ul style="list-style-type: none"> a. a running slope not more than 1:20 (5%)? (CHPC 4.6.2(a)) b. a cross slope not more than 1:50 (2%)? (CHPC 4.6.2(b)) c. a ramp that complies with Section 12.0 of the Accessibility Tool if the slope is steeper than 1:20 (5%)? (CHPC 4.6.2(c)) 				a. b. c.
3.	Is there a threshold of no more than 1.3cm at all entry points? (CHPC 4.2.5)				
4.	Do boardwalks have a curb of at least 7.5cm or guardrails where the boardwalk is more than 60cm above the ground? (CHPC 4.6.5)				
5.	Do guardrails: <ul style="list-style-type: none"> a. have a height of at least 107cm? (CHPC 4.3.1) b. have horizontal rails that are equally spaced no more than 46cm apart? (CHPC 4.3.1) c. have handrails that comply with Section 12.0(7) of the Accessibility Tool? d. have vertical rails that are spaced no more than 10cm apart for visibility if the height exceeds 107cm? (BC page 29) 				a. b. c. d.

13.2 BOARDWALKS AND BRIDGES		YES	NO	N/A	MEASUREMENTS
6.	Do bridges have guardrails on both sides? (CHPC 4.6.5)				
7.	Are the boardwalks and bridges routinely cleared of debris, snow, ice, and other hazards? (CHPC 4.6.4)				
8.	Are boardwalks and bridges well-illuminated day and night to a minimum of 20 lux ? (CHPC 4.6.8)				

14.0 BEACHES	YES	NO	N/A	MEASUREMENTS
1. Do beach access paths: <ul style="list-style-type: none"> a. have a well-maintained accessible surface, such as wood decking or well-compacted crusher dust on well-drained terrain? (NB 3.8.2.4) b. have a minimum of 160cm width? (CSA B651-23, Annex D.10(a)) c. have a running slope of 1:20 (5%) or less? (CHPC 4.12.1) d. have a cross slope of 1:50 (2%) or less? (CHPC 4.12.1) 				a. b. c. d.
2. Are there accessible surfaces, such as a boardwalk or beach mat, provided to allow crossing over sand or other unstable land? (CHPC 4.12.1)				
3. Do accessible surfaces leading into the water not exceed a depth of 75cm at its end? (CHPC 4.12.1)				

14.0 BEACHES	YES	NO	N/A	MEASUREMENTS
<p>4. Do ramps to boardwalks:</p> <p>a. have a running slope of no more than 1:20 (5%)? (CSA B651-23, 8.2.7(a))</p> <p>b. have a cross slope of no more than 1:50 (2%)? (CSA B651-23, 8.2.7(b))</p> <p>c. have a width of at least 120cm? (CSA B651-23, 8.2.7(c))</p> <p>d. have no more than 900cm between landings or intervals?(CSA B651-23, 5.5.4)</p> <p>e. have landings at the top, bottom and intervals that are at least 170cm wide and 170cm long? (CSA B651-23, 8.2.7(d))</p> <p>f. have handrails on both sides between 86cm and 92cm high from the ramp surface? (CSA B651-23, 8.2.7(a)(ii))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p>
<p>5. Are accessible beach pathways free from obstructions (e.g. driftwood, rocks, sand)? (CHPC 4.12.1)</p>				
<p>6. Are beach swimming areas marked off with buoys where there is no abrupt bottom surface change, strong currents or obstruction? (CHPC 4.12)</p>				
<p>7. Is there a certified lifeguard on duty? (SPDOS Appendix C)</p>				

14.0 BEACHES	YES	NO	N/A	MEASUREMENTS
<p>8. Is there accessibility equipment (e.g. water wheels, hippocampes) available on site that:</p> <p>a. is in an identified location that is easy to find? (Ability NB Best Practice)</p> <p>b. can be reserved ahead of time? (Ability NB Best Practice)</p> <p>c. has readily available information online and at the site? (Ability NB Best Practice)</p> <p>d. is well-maintained? (Ability NB Best Practice)</p> <p>e. has staff trained to use it? (Ability NB Best Practice)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>
<p>9. Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? (Ability NB Best Practice)</p>				
<p>10. Are there shaded areas available to allow individuals to get out of the sun or heat? (UDG 3.1.3)</p>				
<p>11. If there are changing facilities or washrooms on site, is there a quiet area available? (Ability NB Best Practice)</p>				

14.0 BEACHES		YES	NO	N/A	MEASUREMENTS
12.	When considering a sensory friendly environment, does the beach have a quiet zone that:				
	a. has shade to provide shelter from the heat and direct sunlight? (SFS)				a.
	b. allows a limited number of people? (SFS)				b.
	c. avoids the use of music, whistles, or noisy equipment? (SFS)				c.
	d. has trained staff in sensory sensitivity? (SFS)				d.
	e. have signage that complies with Section 8.0 of the Accessibility Tool to indicate the location of the quiet zone? (SFS)				e.
13.	If there are power outlets to allow recharging of batteries for electric mobility aids, are they between 45.5cm and 55cm from the ground? (NB 3.8.3.22.1(f))				

15.0 DOCKS	YES	NO	N/A	MEASUREMENTS
1. Does the dock: <ul style="list-style-type: none"> a. have a firm, stable and slip-resistant surface? (CHPC 4.15.1(a)) b. have a width of at least 152cm? (CSP 6.IV.E) c. have no horizontal or vertical joint wider than 1.3cm? (CHPC 4.15.1(b)) d. have edge protection of at least 7.5cm? (CHPC 4.15.1(c)) 				a. b. c. d.
2. Is there signage that complies with Section 8.0 of the Accessibility Tool to identify the location of accessible docks?				
3. Does the ramp to the dock comply with Section 12.0 of the Accessibility Tool ? *Some floating docks may not be able to provide a slope no steeper than 1:12 (8.3%) at all times of the day due to tide changes. Stability may also be affected.				
4. Are fixed accessible docks identified with signage that complies with Section 8.0 of the Accessibility Tool ?				
5. Are ramps and platforms that provide access to large touring or sightseeing boats flush with the embarkation point with at least an 81cm wide gate? (CHPC 4.15.4)				

15.0 DOCKS	YES	NO	N/A	MEASUREMENTS
<p>6. Is there a stepped platform from dock that:</p> <p>a. has a slip-resistant and non-abrasive surface? (CHPC 4.15.4(a))</p> <p>b. has a transfer area of 60cm by 60cm with its top located 45cm from the dock surface? (CHPC 4.15.4(b))</p> <p>c. has steps that are 15cm high, 60cm wide and 45cm deep? (CHPC 4.15.4(c))</p> <p>d. has one continuous handrail along the back of the platform and along the side opposite the transfer space at a height between 30cm and 40cm above the platform nosings? (CHPC 4.15.4(d))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
<p>7. Are dock surfaces of fixed and floating docks no more than 45cm above water level? (CHPC 4.15.4)</p>				
<p>8. Is there an overhanging grab bar to assist entering and exiting boats, kayaks or canoes that:</p> <p>a. is bright and has contrasting colour? (CHPC 4.15.4(a))</p> <p>b. has a circular section of 3cm to 4cm in diameter? (CHPC 4.15.4(b))</p> <p>c. is firmly fixed and stable? (CHPC 4.15.4(c))</p> <p>d. has a top located between 75cm to 85cm from the dock surface? (CHPC 4.15.4(d))</p> <p>e. extends 45cm beyond the dock edge? (CHPC 4.15.4(e))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>

15.0 DOCKS		YES	NO	N/A	MEASUREMENTS
9.	Are there tactile warning strips at the edges of the dock? (UDG 3.3.7)				
10.	Is there supervision of the dock facility by experienced water-certified personnel? (UDG 3.3.7)				
11.	Are there shaded areas available to allow individuals to get out of the sun or heat? (UBG 3.1.3)				

15.1 FISHING STATIONS	YES	NO	N/A	MEASUREMENTS
1. Is there one accessible fishing station for every accessible parking space? (CHPC 4.14.2)				
2. Are there washroom facilities available within 2000cm of the stations? (BC page 25)				
3. Are the fishing stations at least 120cm wide per angler, 375cm for two anglers or 150cm per angler at shore pads? (CHPC 4.14.2)				
4. Are the fishing stations a minimum of 250cm from the entry to the guardrail (CHPC 4.14.2)				
5. Does the dock have guardrails between 81cm to 86cm high? (CHPC 4.14.2)				
6. Does the dock have edge protection of 7.5cm with colour contrast? (CHPC 4.14.2)				
7. Are all accessible fishing stations connected by an accessible route that complies with Section 11.0 of the Accessibility Tool? (CHPC 4.14.2)				
8. Is the surface firm, stable and slip-resistant? (CHPC 4.14.2)				
9. Is there one seat for each two fishing stations? (CHPC 4.14.2)				
10. Are there shaded stations available to allow individuals to get out of the sun or heat? (CHPC 4.14.2)				
11. Are accessible fishing stations integrated in with the rest of the fishing public? (UDG 3.4.16)				
12. If fish cleaning tables are provided, does the table comply with Section 4.1 (13) of the Accessibility Tool?				

16.0 OUTDOOR POOLS	YES	NO	N/A	MEASUREMENTS
1. Is the pool connected to amenities (e.g. washrooms, parking, change rooms, canteens) by unobstructed accessible paths that are at least 150cm wide? (NB 3.8.3.3(a))				
2. Are accessible paths and decking: <ul style="list-style-type: none"> a. slip-resistant and non-abrasive? (TO 1.3.8) b. free of glare? (CHPC 4.13.1(a)) c. non-heat absorbing (light coloured finish)? (TO 1.3.8) d. constructed with adequate drainage to avoid puddles? (TO 1.3.8) 				<ul style="list-style-type: none"> a. b. c. d.
3. For outdoor pools, is the entire deck and pool area surrounded by fencing or walls of at least 180cm in height? (SPDOS 2.1.19.1a)				
4. Is the pool area inspected for damages, sharp or protruding objects and is clear of debris or obstacles (e.g. broken glass)? (CHPC 4.13.1(c))				
5. Are skimmers, gutters, etc., covered with plastic or metal grating that is flush with the pool surface? (CHPC 4.13.1d)				
6. Is the deck leading to the accessible shallow entrance of the pool: <ul style="list-style-type: none"> a. colour contrasted from the pool edge and the walls? (COP - Colour and Brightness Contrast) b. identified by tactile walking surface indicators? (COP - Attention TWSI) c. identified with acoustic signals? (COP - Acoustics) 				<ul style="list-style-type: none"> a. b. c.

16.0 OUTDOOR POOLS	YES	NO	N/A	MEASUREMENTS
<p>7. Does the ramped entry to the pool have:</p> <ul style="list-style-type: none"> a. a maximum slope of 1:12 (8.3%)? (CHPC 4.13.4(a)) b. handrails on both sides between 80cm to 92cm high from the ramp surface to the top of the rail? (CHPC 4.13.4(b)) c. a slip-resistant, non-abrasive surface? (CHPC 4.13.4(d)) d. a width of at least 92cm? (CHPC 4.13.4(e)) e. a water depth at the bottom of the pool not exceeding 75cm? (CHPC 4.13.4) 				<ul style="list-style-type: none"> a. b. c. d. e.
<p>8. Does the stepped platform into the pool have:</p> <ul style="list-style-type: none"> a. a slip-resistant, non-abrasive surface? (CHPC 4.13.2(a)) b. a transfer area at the top which is at least 60cm by 60cm located 45cm from the surface of the water? (CHPC 4.13.2(b)) c. steps which measure 15cm high, 60cm wide and 45cm deep and not below the water surface by more than 30cm deep? (CHPC 4.13.2(c)) d. a continuous handrail along the steps and along the back of the transfer area which is at a height between 30cm to 40cm? (CHPC 4.13.2(d)) 				<ul style="list-style-type: none"> a. b. c. d.

16.0 OUTDOOR POOLS		YES	NO	N/A	MEASUREMENTS
9.	Is there accessibility equipment (e.g. pool wheelchairs, hippocampes) available on site that: a. is in an identified location that is easy to find? (Ability NB Best Practice) b. can be reserved ahead of time? (Ability NB Best Practice) c. has readily available information online and at the site? (Ability NB Best Practice) d. is well-maintained? (Ability NB Best Practice) e. has staff trained to use it? (Ability NB Best Practice)				a. b. c. d. e.
10.	Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? (Ability NB Best Practice)				
11.	If there is a seating area (e.g. canteen), does it comply with Section 4.1 of the Accessibility Tool ?				
12.	Are there shaded areas available to allow individuals to get out of the sun or heat? (UDG 3.1.3)				
13.	Are lifeguard chairs painted in highly contrasting colours? (TO 1.3.8)				
14.	When considering a sensory friendly environment: a. Is there comfortable seating provided in a quiet area? (SFS) b. Is the environment scent-free? (SFS) c. Are sensory friendly swimming hours provided? (e.g. limited noise, limited swimmers, etc.) (SFS)				a. b. c.

17.0 SPLASH PADS	YES	NO	N/A	MEASUREMENTS
1. Is there a washroom/showers located within 1000cm to the splash pad which complies with Sections 5.0 to 5.5 of the Accessibility Tool?				
2. If there are change rooms available, do they comply with Section 7.1 of the Accessibility Tool?				
3. Is the surface of the pad and the surrounding deck constructed of an accessible, slip-resistant material? (UDG 3.3.4)				
4. Is there colour contrast between the concrete pad, other surfaces and the play components to provide visual cues? (UDG 3.3.4)				
5. Are there any tactile walking surface indicators to indicate the path of travel to the accessible entrance? (COP - Tactile Walking Surface Indicators)				
6. Is there a variety of play components that sprays and splashes (e.g. ground level, mid- level and overhead)? (TO 1.3.9)				
7. Is there a safe play zone around each play component of at least 180cm on all sides? (CSA Z614-20, 14.2.1.2)				
8. Are skimmers, gutters, etc., covered with plastic or metal grating that is flush with the pool surface with openings no wider than 0.6cm ? (UDG 3.3.4)				
9. Are there activation buttons at ground level or reachable from a seated position for individuals with a mobility device? (Ability NB best practice)				

17.0 SPLASH PADS		YES	NO	N/A	MEASUREMENTS
10.	Is there accessibility equipment (e.g. beach wheelchairs, hippocampes) available on site that: a. is in an identified location that is easy to find? <i>(Ability NB Best Practice)</i> b. can be reserved ahead of time? <i>(Ability NB Best Practice)</i> c. has readily available information online and at the site? <i>(Ability NB Best Practice)</i> d. is well-maintained? <i>(Ability NB Best Practice)</i> e. has staff trained to use it? <i>(Ability NB Best Practice)</i>				a. b. c. d. e.
11.	Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? <i>(Ability NB Best Practice)</i>				
12.	Are there shaded areas available to allow individuals to get out of the sun or heat? <i>(UDG 3.3.4)</i>				

18.0 PLAYGROUNDS	YES	NO	N/A	MEASUREMENTS
1. Does the parking comply with Section 10.0 of the Accessibility Tool ?				
2. Are accessible washrooms located on or near the playground? (CSA Z614:20, G.7)				
3. Are the play surfaces constructed of an accessible substance (e.g. Pour in place (PIP) rubber surfacing)? (CSA Z614:20, 10.3.1)				
4. If there is a border around the periphery of the play area, does it have at least two entry points of 150cm wide to allow to wheelchairs to pass? (RHFSP page 45)				
5. Are play surfaces free from elongated openings or gaps greater than 1.3cm in width in both directions? (NB 3.3.6.5)				
6. Are the play structure surfaces inspected regularly for damages, water pooling, debris, broken glass, or sharp objects? (CSA Z614:20, 11.3.1)				
7. Do the exterior paths of travel comply with Section 11.0 of the Accessibility Tool ?				
8. Is there a 180cm obstacle-free protective surfacing zone around each ground level play structure? (CSA Z614:20, 14.1.1)				

18.0 PLAYGROUNDS	YES	NO	N/A	MEASUREMENTS
9. Do ramps connecting ground level components to elevated components have: <ul style="list-style-type: none"> a. a slope of at least 1:20 (5%) for exterior ramps or 1:16 (6.3%) for interior ramps? (CSA Z614:20, H.4.4.1.3) b. a run between intervals no longer than 365cm? (CSA Z614:20, H.4.4.5.2) c. a width of at least 92cm to 100cm between handrails? (CSA B651-23, 5.5.8(b)) d. level landings at top, intervals and bottom of 152cm wide by 152cm long? (CSA Z614:20, H.4.4.5.2) e. handrails on both sides that are between 58cm to 71cm high? (CSA Z614:20, H.4.4.5.2) f. no thresholds greater than 1.3cm high? (CSA B651-23, 5.2.6) 				<ul style="list-style-type: none"> a. b. c. d. e. f.
10. Is there at least one turning space provided on each level that is at least 153cm in diameter? (CSA Z614:20, H.4.6.1)				
11. Do elevated accessible routes have a width of at least 92cm ? (CSA Z614:20, H.4.4.4.3.1)				
12. Is there at least 73cm by 123cm of clear ground space provided in front of all elevated accessible components? (CSA Z614:20, H.4.6.2)				
13. Are at least 50% of the elevated play components located on an unobstructed accessible path that is connected to entry and exit points? (CSA Z614:20, H.4.2.3)				

18.0 PLAYGROUNDS	YES	NO	N/A	MEASUREMENTS
<p>14. Do the play components that require transfer to the entry point or seat have:</p> <ul style="list-style-type: none"> a. 28cm to 61cm of clear ground space in front? (CSA Z614:20, H.4.6.4) b. a means of support for transferring (e.g. handrails, grab bars)? (CSA Z614:20, H.4.6.5) c. a space or seat with a level surface that is at least 60cm deep by 60cm wide? (CHPC 4.10) d. a space or seat no higher than 150cm from the ground? (CSA Z614:20, 15.10.7) 				<ul style="list-style-type: none"> a. b. c. d.
<p>15. Do play components, such as water or sand tables have:</p> <ul style="list-style-type: none"> a. a height to the bottom of the table of at least 61cm? (CSA Z614:20, H.4.6.3) b. a height to the top of the table of at least 78cm? (CSA Z614:20, H.4.6.3) c. knee clearance depth of at least 43cm? (CSA Z614:20, H.4.6.3) d. a width of at least 76cm? (CSA Z614:20, H.4.6.3) 				<ul style="list-style-type: none"> a. b. c. d.

18.0 PLAYGROUNDS	YES	NO	N/A	MEASUREMENTS
<p>16. Do freestanding play components, such as diggers, spring rockers, have:</p> <p>a. a clear ground space that is at least 76cm by 122cm with a slope no greater than 1:50 (2%) in all directions? (CSA Z614:20, H.4.6.2)</p> <p>b. a transfer space conforming to Section 18.0(14) of the Accessibility Tool where required?</p> <p>c. at least one turning space that is either 152cm in diameter or a T-shaped space that is within a 152cm minimum square, with arms and base that are at least 91 cm, and each arm of the T and the base shall be clear of obstructions for 61cm in each direction? (CSA Z614:20, H.4.6.1)</p> <p>d. seated arm reach requirements as per table in section H.4.6.6? (CSA Z614:20, H.4.6.6)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p>
<p>17. Does the number of ground level play components meet the recommended minimum of Table H1 in CSA Z614:20, Annex H?</p>				
<p>18. Is there a variety of play components integrated throughout the play structure to foster interaction and socialization among all children? (CSA Z614:20, H4.5.1.2.3)</p>				
<p>19. Does the play area provide shaded or cooling areas to allow individuals and/or service animals to get out of the sun or heat? (RHFSP page 27)</p>				

18.0 PLAYGROUNDS		YES	NO	N/A	MEASUREMENTS
20.	<p>Are there accessible swings that:</p> <ul style="list-style-type: none"> a. are located in their own area, separate from other play structures? (CHPC 4.10.1) b. are set back twice the height of the swing beam from any obstacle? (CHPC 4.10.1) c. are suspended at a variety of heights? (CHPC 4.10.1) d. are located on an accessible surface? (CHPC 4.10.1) e. are connected to the main path of travel by an unobstructed accessible path? (CHPC 4.10.1) 				<ul style="list-style-type: none"> a. b. c. d. e.
21.	<p>Are there accessible slides that:</p> <ul style="list-style-type: none"> a. have a height of no more than 162cm? (CHPC 4.10.1) b. have an incline surface that does not exceed 30 degrees?(CHPC 4.10.1) c. have chute side rails at least 7.5cm high? (CHPC 4.10.1) d. have an exit zone that is a minimum of 40cm long and between 23cm to 38cm high from the ground? (CHPC 4.10.1) e. are made of plastic to avoid heat absorption? (CHPC 4.10.1) 				<ul style="list-style-type: none"> a. b. c. d. e.
22.	<p>Are there tactile indicators and colour contrast strips throughout the play structure for persons with a visual disability? (COP - Playground and Parks for Children)</p>				
23.	<p>Are there quiet play areas connected to an accessible path from the main structure for children to play? (RHFSP page 20)</p>				

19.0 PARK AMENITIES	YES	NO	N/A	MEASUREMENTS
<p>1. Benches:</p> <p>a. Do the benches have a seat height between 43cm to 48.5cm? (CSA B651-23, 6.7.2.2(b))</p> <p>b. Is there a minimum clear ground space of 85cm wide by 139cm long at one end of the bench? (CSA B651-23, 6.7.2.1(c))</p> <p>c. Is the bench adjacent to an accessible route? (CHPC 5.1.7)</p> <p>d. Is the surface around the bench colour contrasted from the trail or have tactile indicators? (MPADG page 32)</p> <p>e. Is there a variety of seating options provided (e.g. some with backs, some with arm rests, some with both)? (CSA B651-23, 6.7.2.2(c))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p>

19.0 PARK AMENITIES	YES	NO	N/A	MEASUREMENTS
<p>2. Picnic tables:</p> <p>a. Are 10% of the picnic tables wheelchair accessible? (CHPC 4.8)</p> <p>b. Are accessible tables marked with the <i>International Symbol of Access</i>?</p> <p>c. Are the picnic tables linked to the trail by an unobstructed accessible path that is at least 180cm in width? (CSA B651-23, 8.2.2)</p> <p>d. Are the picnic tables fixed or stable on a clear, level, well-drained, slip-resistant surface (e.g. asphalt, concrete or crusher dust)? (CSA B651-23, 8.6.3.2(a))</p> <p>e. Is the surface colour contrasted from the platform? (Ability NB Best Practice)</p> <p>f. Is there a minimum of 200cm width of clear access from all sides? (CSA B651-23, 8.6.3.2(a))</p> <p>g. Does the picnic table have an overhanging edge that:</p> <ul style="list-style-type: none"> • extends out at least 48 cm? (CSA B651-23, 8.6.3.2, Figure 64a) • is at least 68.5cm high? (CSA B651-23, 8.6.3.2(b)) • has 82cm width of clear access? (CSA B651-23, 8.6.3.2(b)) • has a knee clearance of at least 43cm deep? (CSA B651-23, 8.6.3.2(b)) <p>h. Are there accessible picnic tables or shelters in a variety of areas (e.g. in shaded areas)? (BC page 23)</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p> <p>g.</p> <ul style="list-style-type: none"> • • • • <p>h.</p>

19.0 PARK AMENITIES	YES	NO	N/A	MEASUREMENTS
<p>3. Garbage bins:</p> <p>a. Are they located on a firm and level surface with 75cm to 120cm width of clear access around the bin? (CHPC 5.1.5)</p> <p>b. Do they have an opening between 75cm and 90cm high from the ground? (CHPC 5.1.5)</p>				<p>a.</p> <p>b.</p>
<p>4. Water fountains/bottle filling stations:</p> <p>a. Are they located along an accessible route? (NB 3.8.3.10.1(a))</p> <p>b. Do they have a clear, unobstructed floor area of at least 82cm by 139cm in front of them? (CSA B651-23, 6.1.6(a), Figure 40)</p> <p>c. Do they have knee clearance under the fountain that is at least 82cm wide, 20cm deep and 68.5cm in height? (CSA B651-23, 6.1.6(b), Figure 40)</p> <p>d. Do they have a spout that is between 75cm and 90cm from the ground with a flow of water parallel to the front of the fountain? (CSA B651-23, 6.1.2(a))</p> <p>e. Do they operate with controls that are either automatic, located on the front or located on both sides of the fountain? (NB 3.8.3.10(e)(ii))</p> <p>f. Do they have colour contrast to the wall? (CSA B651-23, 6.1.5)</p> <p>g. If the water fountain/bottle filling station is cantilevered, is it cane-detectable or recessed with a toe space of at least 82cm wide, 23cm deep and 23cm high? (CSA B651-23, 6.1.6(c))</p>				<p>a.</p> <p>b.</p> <p>c.</p> <p>d.</p> <p>e.</p> <p>f.</p> <p>g.</p>

19.0 PARK AMENITIES	YES	NO	N/A	MEASUREMENTS
5. Service animal relief areas: <ul style="list-style-type: none"> a. Are they adjacent to an unobstructed accessible path of travel? (CK 4.3.19) b. Are they located away from vehicular access routes? (CK 4.3.19) c. Are they on a grassy area of at least 150cm by 150cm? (CK 4.3.19) d. Are they equipped with a garbage can that complies with Section 19.0 (3) of the Accessibility Tool? 				<ul style="list-style-type: none"> a. b. c. d.
6. Are there are accessible power outlets to allow recharging of batteries for electric mobility aids that are located between 45.5cm and 55cm from the ground? (NB 3.8.3.22.1(f))				

20.0 OUTDOOR BASKETBALL COURTS		YES	NO	N/A	MEASUREMENTS
1.	Does the parking comply with Section 10.0 of the Accessibility Tool ?				
2.	Is the court connected to parking by an unobstructed accessible path that complies with Section 11.0 of the Accessibility Tool ?				
3.	If there is an outdoor ramped entry to the basketball court/playing surface, does the ramp comply with Section 12.0 of the Accessibility Tool ?				
4.	Is the size of the playing surface at least 2560cm long by 1200cm wide from the inside of the boundary lines? (BM, 2019)				
5.	Is the playing surface of the basketball court: <ul style="list-style-type: none"> a. level, firm and slip-resistant? (BM, 2019) b. clear of obstructions (e.g. rocks, pooling water, leaves)? (Ability NB Best Practice) c. have boundary lines marking the playing area? (BM, 2019) d. colour contrasted from the basketball court line? (BM, 2019) 				a. b. c. d.
6.	Is there a minimum of 200cm from the edge of the outer boundary line to the wall, fence or other barrier that is constructed of a material that will not leave debris on the court, such as well-compacted crusher dust? (BM, 2019)				
7.	Is there a designated space around the basketball court sidelines for spectators that is at least 450cm long and 200cm wide and connected to an accessible path? (BM, 2019)				
8.	Does the basketball court have a fence? If so, does the chain link fencing have two access gates that are at least 150cm wide to allow sport wheelchairs to enter? (AODA 80.23)				

20.0 OUTDOOR BASKETBALL COURTS		YES	NO	N/A	MEASUREMENTS
9.	Does the basketball net have: a. a rectangle shaped, glass backboard with a breakaway rim? (BM, 2019) b. a height adjusting pole? (BM, 2019) c. anti-whip netting? (BM, 2019) d. pole padding? (BM, 2019)				a. b. c. d.
10.	If team benches are provided on the sidelines, are they: a. permanent or removable? (BM, 2019) b. at least 120cm wide and 180cm long? (BM, 2019)				a. b.
11.	Does the basketball court have picnic tables, garbage bins, benches or water fountains? If so, do they comply with Section 19.0 of the Accessibility Tool ?				
12.	Are there washrooms/showers in the facility that comply with Sections 5.0 to 5.5 of the Accessibility Tool ?				
13.	Is there way finding signage that complies with Section 8.0 of the Accessibility Tool indicating where the washrooms are located from the basketball courts?				
14.	Is the basketball court well-illuminated to at least 100 lux at all times of the day? (BM, 2019)				

21.0 CAMPGROUNDS	YES	NO	N/A	MEASUREMENTS
1. Does the parking area comply with Section 10.0 of the Accessibility Tool ?				
2. Are accessible features (e.g. campsites, washrooms, trails) clearly marked with wayfinding signage that complies with Section 8.0 of the Accessibility Tool from the main gate?(CHPC 4.2)				
3. Are wheelchair or power scooter users able to access all primary areas and amenities (e.g. beaches, pools, trails) within the campground using unobstructed accessible paths of travel of at least 150cm wide? (CHPC 3.3.1)				
4. If all primary areas and amenities are not able to be accessed by unobstructed accessible paths, is there an accessible shuttle service available? (Ability NB Best Practice)				
5. If there are accessible power outlets to allow recharging of batteries for electric mobility aids or electric hookups for RVs, are they between 45.5cm and 55cm from the ground? (NB 3.8.3.22.1(f))				
<p>6. Is there adapted recreation equipment (e.g. sit skis, pool wheelchairs, handcycles) available on site that:</p> <ul style="list-style-type: none"> a. is in an identified location that is easy to find? (Ability NB Best Practice) b. can be reserved ahead of time? (Ability NB Best Practice) c. has readily available information online and at the site?(Ability NB Best Practice) d. is well-maintained? (Ability NB Best Practice) e. has staff trained to use it? (Ability NB Best Practice) 				<ul style="list-style-type: none"> a. b. c. d. e.

21.0 CAMPGROUNDS	YES	NO	N/A	MEASUREMENTS
7. Is there a safe, locked space available to store personal equipment (e.g. power wheelchairs, walkers) while using the facility's equipment? <i>(Ability NB Best Practice)</i>				
8. Are staff trained in first aid and CPR in case of medical emergency? <i>(CSA Z614:20, Annex A)</i>				
9. Do the entrances to any communal buildings comply with Section 1.0 of the Accessibility Tool?				
10. Do the washrooms comply with Sections 5.0 to 5.5 of the Accessibility Tool?				
11. Do the trails comply with Section 13.0 of the Accessibility Tool?				

21.1 CABINS AND YURTS	YES	NO	N/A	MEASUREMENTS
1. Is there an unobstructed accessible path that connects the cabin site to accessible parking that has grade changes less than 1:20 (5%) ? (CHPC 3.3)				
2. Does the living space have a minimum of 92cm of clear space between fixed elements such as cabins, fire pits, picnic tables and barbecue grills? (CHPC 4.7.2)				
3. Are the edges of the campsite well-defined with a contrasting texture or colour change? *Vegetation and underbrush may provide an adequate texture or colour contrast. (CHPC 4.7.3)				
4. If there is a vertical drop near the cabin/yurt that exceeds 60cm , is there a guardrail that is at least 107cm high? (CHPC 4.2.5)				
5. Do the interior spaces comply with Sections 4.0 to 4.3 of the Accessibility Tool ?				
6. Are there electrical outlets available that: a. have a height between 40cm and 55cm from the floor?(NB 3.8.3.23.1(d)) b. have a clear floor space of 139cm by 82cm in front of them? (CSA B651- 23, 4.3.2)				a. b.
7. Do the beds have a clear floor area of at least 82cm by 139cm on at least two sides of the bed? (CSA B652-23, 5.11.1.2)				
8. If there is a coat hook, is it mounted not more than 120cm from the floor and project not more than 5cm from the wall? (NB 3.8.3.11(g))				

21.1 CABINS AND YURTS	YES	NO	N/A	MEASUREMENTS
9. Are there unobstructed accessible paths that connect the cabin site to washrooms and other amenities continuous, free of obstacles, and have grade changes less than 1:20 (5%) ? (CHPC 3.3)				
10. Do water hook-ups have: <ul style="list-style-type: none"> <li data-bbox="170 402 953 467">a. a width of clear access in front of 75cm by 120cm? (CHPC 5.1.1(a)) <li data-bbox="170 500 953 565">b. a height between 75cm to 90cm from the ground? (CHPC 5.1.4(a)) <li data-bbox="170 597 974 662">c. controls between 40cm to 120cm from the ground? (CHPC 5.1.1(b)) <li data-bbox="170 695 1045 760">d. controls operable with one hand without tight grasping or twisting of the wrist? (CHPC 5.1.1(c)) 				a. b. c. d.
11. Do the water hook-ups have a drain that is flush with the grade to prevent water pooling? (CHPC 5.1.4)				

21.2 UNSERVICED CAMPSITES	YES	NO	N/A	MEASUREMENTS
1. Are the accessible campsites visually equal in quality to other campsites while offering accessible or barrier-free options (no obvious modifications such as an entirely paved site, absence of vegetation or trees, segregated from other sites, etc.)? (UDGBC page 61)				
2. Are 5% of all campsites designed to be accessible camp sites? (UDGBC page 61)				
3. Are accessible campsites indicated by signage that complies with Section 8.0 of the Accessibility Tool with the <i>International Symbol of Access</i> on the campground layout maps? (CHPC 4.7.7)				
4. Does the living space have a minimum of 92cm of clear space between fixed elements such as tent pads, fire pits, picnic tables and barbecue grills? (CHPC 4.7.2)				
5. Do unobstructed accessible paths that connect the campsite to accessible parking, washrooms and other amenities continuous, have grade change no steeper than 1:20 (5%) , and free of obstacles? (CHPC 3.3)				
6. Are camp sites located within 6000cm to the nearest accessible washroom/showers? (CHPC 4.7.5)				
7. Are tent platforms on a natural-looking firm, level and accessible surface with a minimum of 430cm by 500cm in dimension? (CHPC 4.7.2)				
8. Are the platforms easily accessible with: <ul style="list-style-type: none"> a. a threshold of no more than 1.3cm? (CHPC 3.3.4) b. a grade change no steeper than 1:20 (5%)? (CHPC 3.3.2) c. a cross slope no more than 1:50 (2%)? (CHPC 3.3.2) 				<ul style="list-style-type: none"> a. b. c.


21.2 UNSERVICED CAMPSITES		YES	NO	N/A	MEASUREMENTS
9.	Are the edges of the campsite well-defined with a contrasting texture or colour change? *Vegetation and underbrush may provide an adequate contrast. (CHPC 4.7.3)				
10.	If there is a vertical drop near the campsite that exceeds 60cm , is there a guardrail that is at least 107cm high? (CHPC 4.2.5)				
11.	Is the designated parking space situated as close as possible to the accessible camp site? *The <i>NB Barrier-Free Building Code</i> requires that the designated parking space must be located within 5000cm of an accessible entrance of a building. However, carrying camping gear at this distance may prove difficult. (CHPC 2.1.1)				
12.	Does the fire pit have a minimum of 150cm width of clear access, have sides between 45cm to 60cm high and have a fire building surface no less than 23cm from the ground? (BC page 21)				
13.	Do garbage bins comply with Section 19.0(3) of the Accessibility Tool ? *Please be aware that some bear-proof bins may be difficult to open. In some cases, safety overrides accessibility.				
14.	If the bins are located on an elevated platform, is the platform easily accessible with a threshold of no more than 1.3cm and a grade change no steeper than 1:20 (5%) ? (CHPC 3.3.2; 3.3.4)				
15.	Do pedestal grills have a minimum of 120cm width of clear access, have a cooking surface that is between 75cm and 90cm high and have a knee clearance of 68cm high? (BC page 21)				
16.	Are there sheltered or shaded areas available near the tent platform? (BC page 23)				

21.3 SERVICED (RV) SITES	YES	NO	N/A	MEASUREMENTS
1. Are accessible camping sites at least 762cm by 884cm to accommodate accessible RVs with a lift? (CSP Section 9, III (B))				
2. Are unobstructed accessible paths that connect the RV site to accessible parking, washrooms and other amenities continuous and free of obstacles? (CHPC 3.3)				
3. Do electrical and water hook-ups have: <ul style="list-style-type: none"> a. a width of clear access in front of 75cm by 120cm? (CHPC 5.1.1(a)) b. a height between 75cm to 90cm from the ground? (CHPC 5.1.4(a)) c. controls between 40cm to 120cm from the ground? (CHPC 5.1.1(b)) d. controls operable with one hand without tight grasping or twisting of the wrist? (CHPC 5.1.1(c)) 				<ul style="list-style-type: none"> a. b. c. d.
4. Do the water hook-ups have a drain that is flush with the grade to prevent water pooling? (CHPC 5.1.4)				
5. Does the living space have a minimum of 92cm of clear space between fixed elements such as tent pads, fire pits, picnic tables and barbecue grills? (CHPC 4.7.2)				
6. Are camp sites located within 6000cm to the nearest accessible washroom/showers? (CHPC 4.7.5)				
7. Are the platforms easily accessible with a threshold of no more than 1.3cm and a grade change no steeper than 1:20 (5%) ? (CHPC 3.3.2; 3.3.4)				
8. Are the edges of the campsite well-defined with a contrasting texture or colour change? *Vegetation and underbrush may provide an adequate contrast. (CHPC 4.7.3)				

21.3 SERVICED (RV) SITES	YES	NO	N/A	MEASUREMENTS
9. If there is a vertical drop near the campsite that exceeds 60cm , is there a guardrail that is at least 107cm high? (CHPC 4.2.5)				
10. Does the fire pit have a minimum of 150cm width of clear access, have sides between 45cm to 60cm high and have a fire building surface no less than 23cm from the ground? (BC page 21)				
11. Do garbage bins comply with Section 19.0(3) of the Accessibility Tool ? *Please be aware that some bear-proof bins may be difficult to open. In some cases, safety overrides accessibility.				
12. If the bins are located on an elevated platform, is the platform easily accessible with a threshold of no more than 1.3cm and a grade change no steeper than 1:20 (5%) ? (CHPC 3.3.2; 3.3.4)				
13. Do pedestal grills have a minimum of 120cm width of clear access, have a cooking surface that is between 75cm and 90cm high and have a knee clearance of 68cm high? (BC page 21)				
14. Are there sheltered or shaded areas available near the tent platform? (BC page 23)				
15. Does the campsite have a picnic table? If so, does it comply with Section 19.0(2) of the Accessibility Tool ?				

Strengths and Creative Features

We noted the following strengths of the site(s):

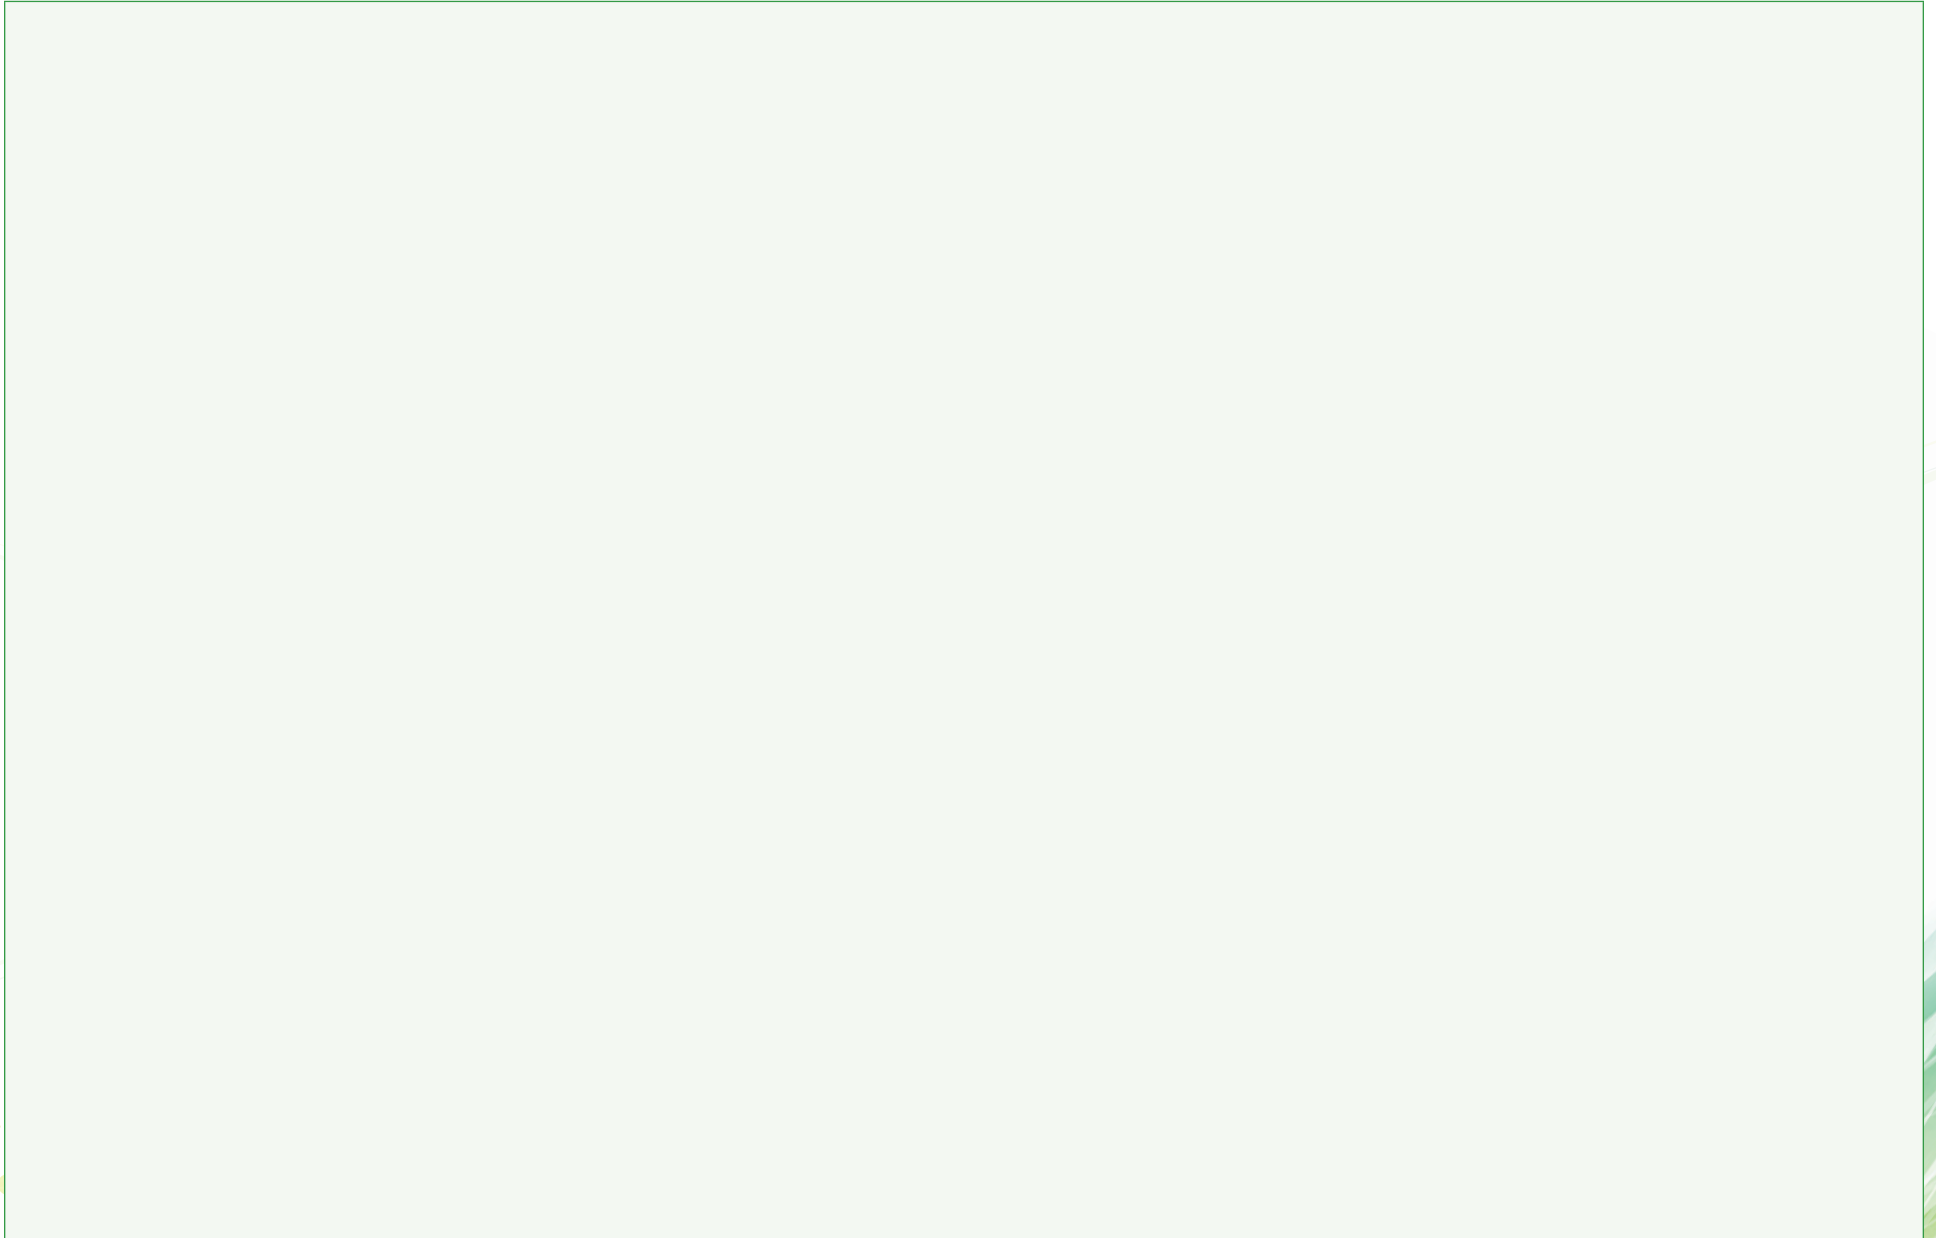


FOR OPERATIONAL GUIDANCE ONLY

Recommendations

Based on our review, we propose the following recommendations:

We understand that some of these recommendations will be possible only in a major renovation (e.g. update of power door, installation of new elevator) but many may be possible with minimal modifications.

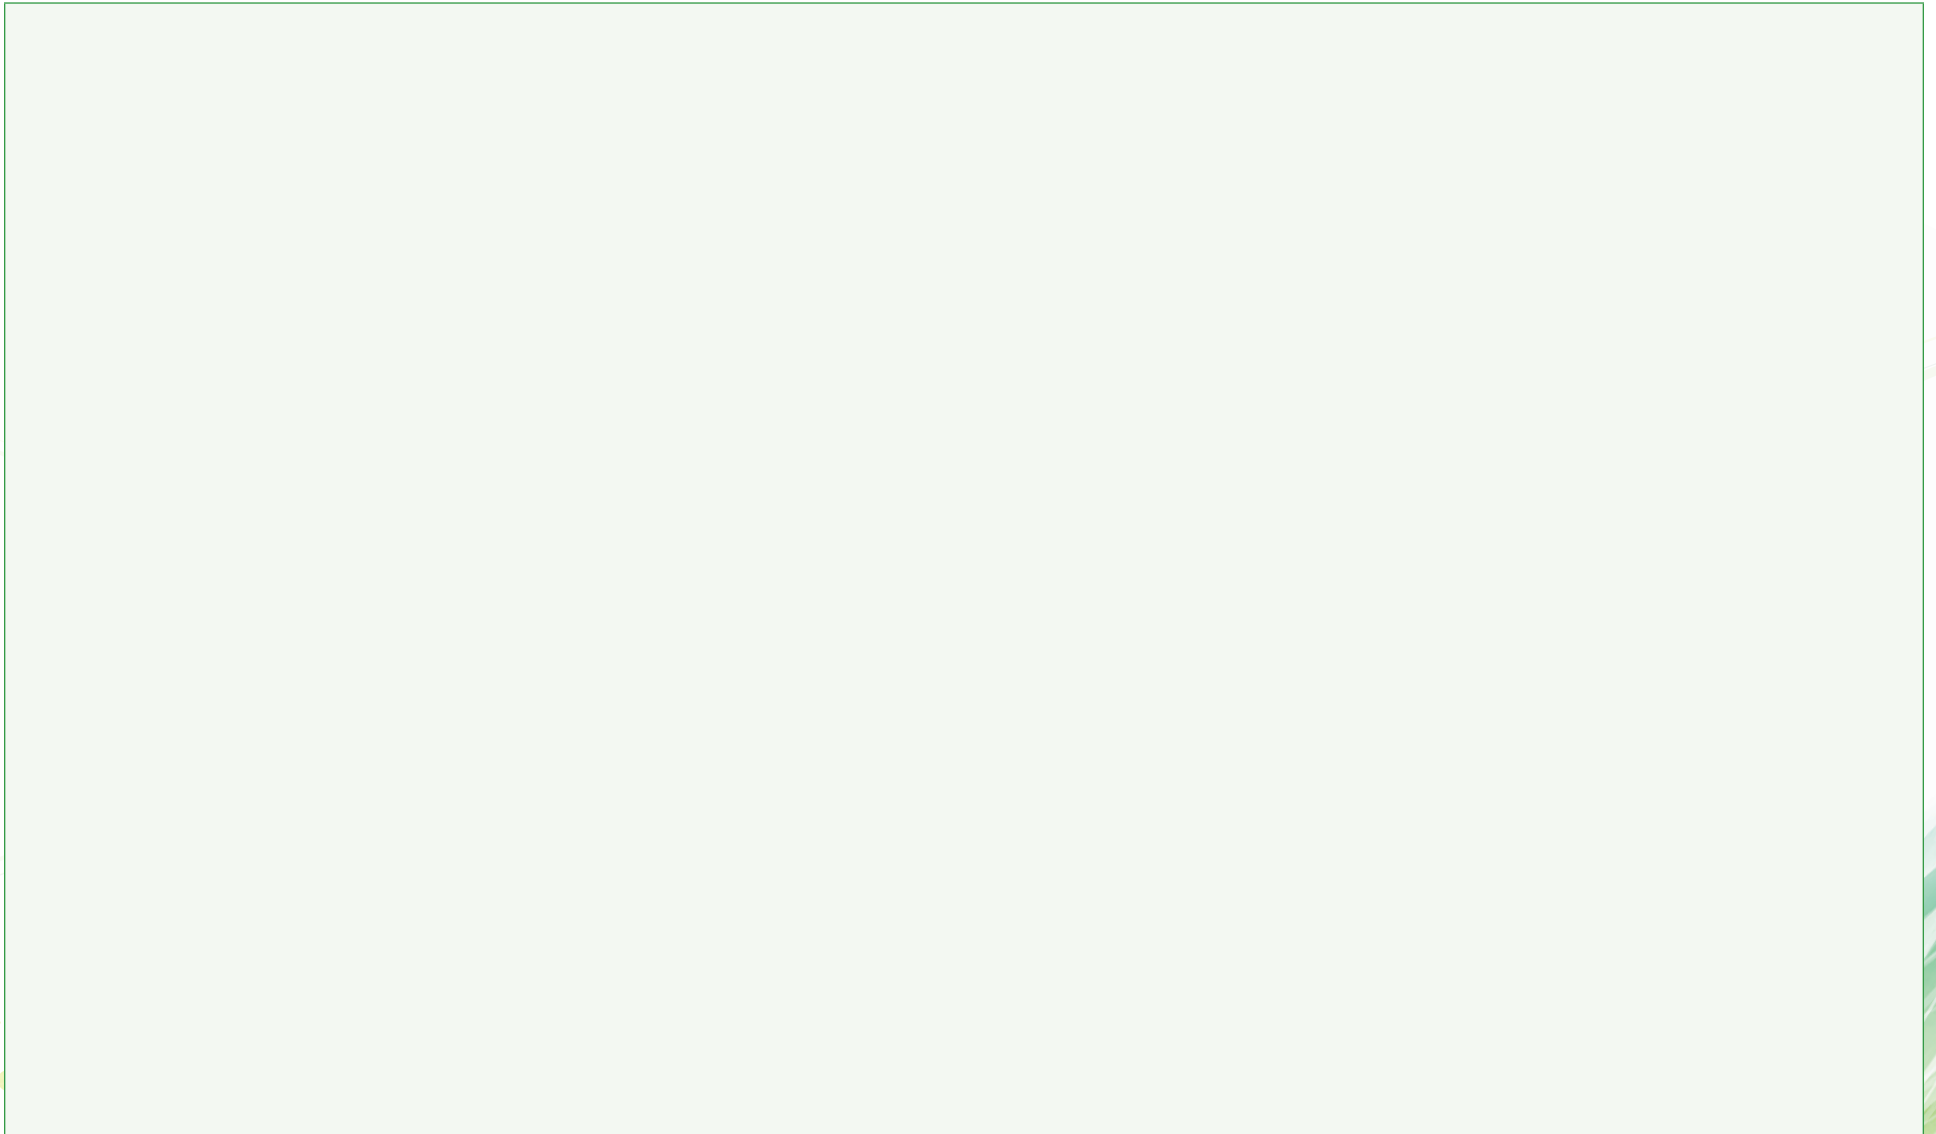

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies the majority of the page's content area.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies the majority of the page below the header.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.

Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.


Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.


Recommendations

A large, empty rectangular box with a light green gradient background, intended for recommendations. The box is outlined in a thin green border and occupies most of the page below the header.


Recommendations



Recommendations



Recommendations




Recommendations




Design Resources

We recommend consulting the following design resources:

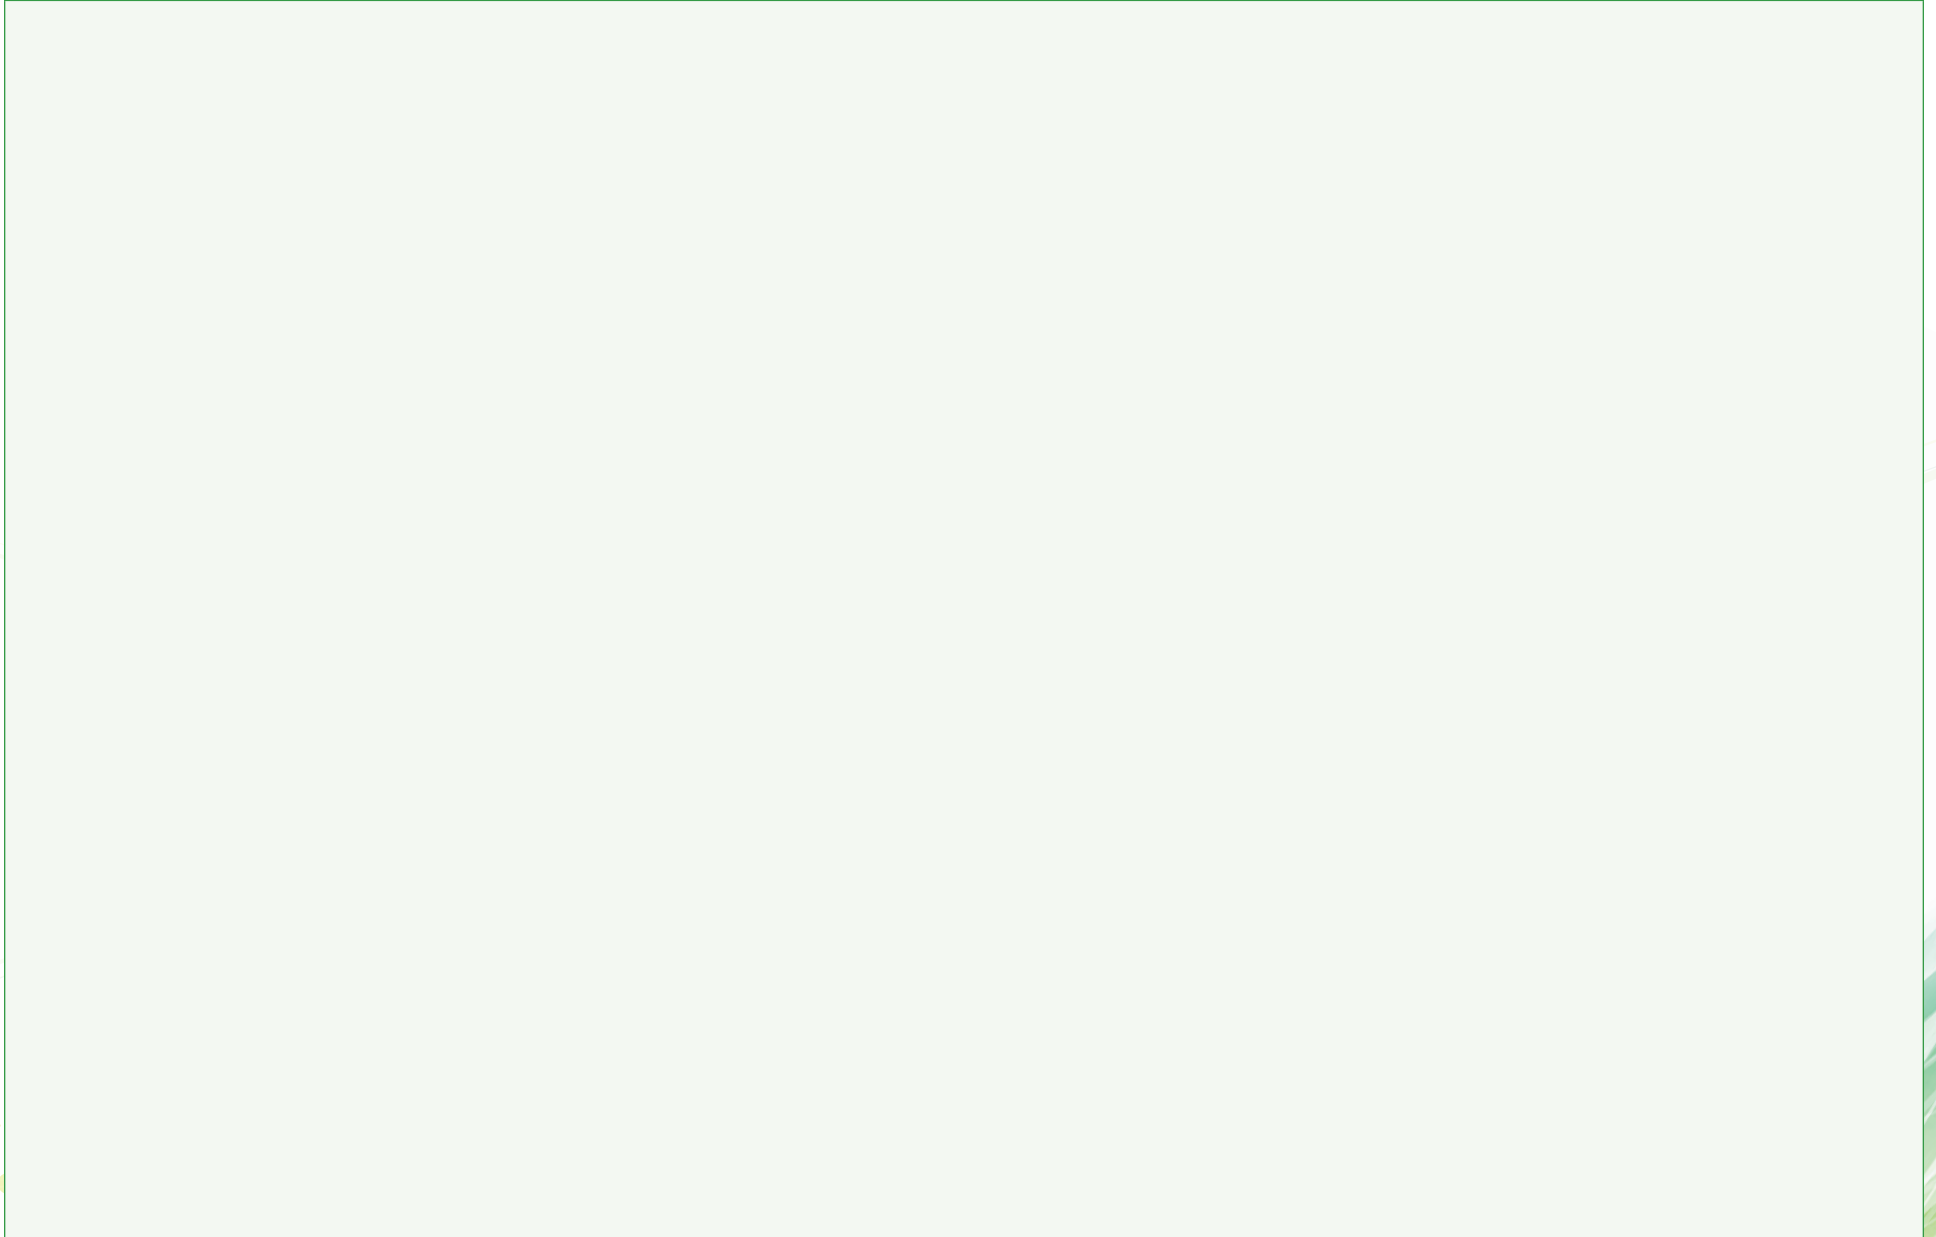


Funding Sources

We recommend the following potential funding sources:

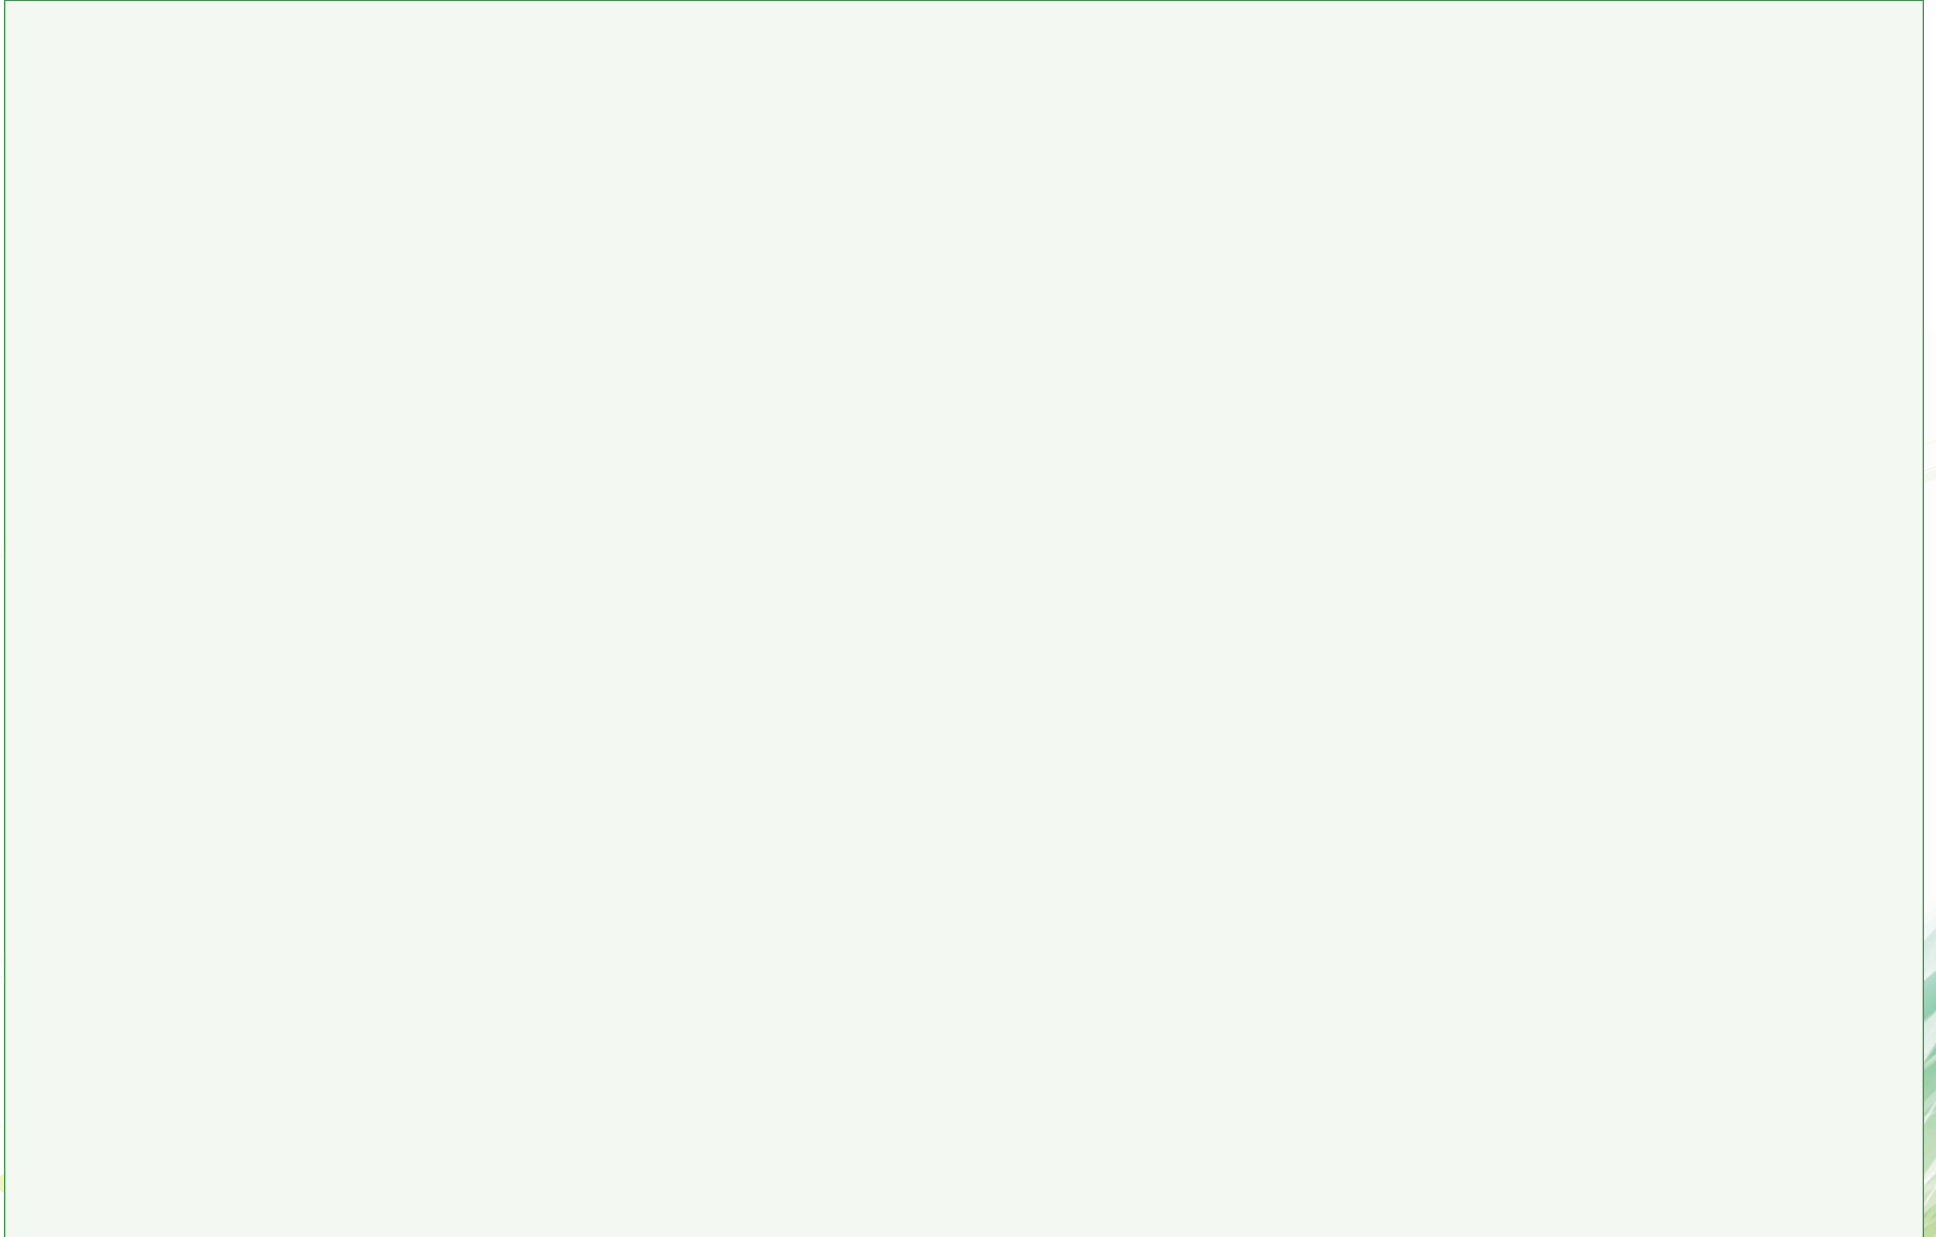

Employment Assistance Services

We recommend the following employment assistance services that may assist with the recruitment and retention of employees with a disability:



FOR OPERATIONAL GUIDANCE ONLY

Legend

ACRONYM	DOCUMENT OR WEBSITE
ADA	American Disability Act. (2010) <i>ADA Standards for Accessible Design</i> . https://www.ada.gov/law-and-regs/design-standards/2010-stds/
ADANN	ADA National Network: Information, Guidance, and Training on the American with Disabilities Act (2015) <i>ADA- A Planning Guide for Making Temporary Events Accessible to People with Disabilities</i> . https://adata.org/sites/adata.org/files/files/EventPlanningGuide_Final_2015.pdf
AODA	Accessibility for Ontarians with Disabilities Act. (2005). <i>O. Reg. 191/11: INTEGRATED ACCESSIBILITY STANDARDS</i> . https://www.ontario.ca/laws/regulation/110191#BK153
ASNB	Alzheimer's Society of New Brunswick. (2022). <i>Making a Dementia-Inclusive Resource Centre</i> . https://alzheimer.ca/nb/en/about-us/our-resource-centres/making-dementia-inclusive-resource-centre
BC	BC Parks. (2008). <i>Report on Accessible Parks and Trails in British Columbia: Accessible Parks and Trails Assessment Toolkit Appendices A-E</i> . https://www.slideshare.net/srains/canada-accessible-parks-toolkit
BM	Basketball Manitoba. (2019). <i>Basketball Manitoba Optimum Outdoor Basketball Facility Specifications</i> . https://docs.google.com/document/d/1yybVgwLPiROtmxBa_KjhbkuOG1PmCCSRmN5-NBMYLtM/edit
BROCK	Brock University (2014). <i>Brock Accessibility Handbook</i> . https://brocku.ca/human-rights/wp-content/uploads/sites/208/2014-Facility-Accessibility-Design-Standards.pdf
CGOL	Community Services Block Grant (2021). <i>Canadian Guidelines for Outdoor Lighting (Low-Impact Lighting) for Dark-Sky Protection Programs</i> . https://csbg.ca/articles/CGOL.PDF
CHH	Canadian Hard of Hearing Association. (2008). <i>Universal Design & Barrier-Free Access: Guidelines for Persons with Hearing Loss</i> . https://www.chs.ca/sites/default/files/uploads/universal_design_and_barrier-free_access_hardofhearing.pdf
CHPC	Canadian Heritage Parks Canada. (2019). <i>Design Guidelines for Accessible Outdoor Recreation Facilities</i> . https://publications.gc.ca/collections/collection_2020/pc/R64-182-7-1994-eng.pdf

FOR OPERATIONAL GUIDANCE ONLY

Legend

ACRONYM	DOCUMENT OR WEBSITE
CMHCB	Canadian Mortgage and Housing Corporation (2016). <i>Accessible Housing by Design- Bathrooms</i> . https://www.cmhc-schl.gc.ca/en/professionals/industry-innovation-and-leadership/industry-expertise/accessible-adaptable-housing/accessible-housing-by-design/accessible-housing-by-design-bathrooms
CMHCK	Canadian Mortgage and Housing Corporation (2016). <i>Accessible Housing by Design- Kitchens</i> . https://assets.cmhc-schl.gc.ca/sf/project/cmhc/pubsandreports/pdf/65588.pdf?rev=b1da6e33-7249-417b-8712-f9e870506cf3
CNIB	CNIB (2018). <i>Clear Print Accessibility Guidelines</i> . https://cnib.ca/sites/default/files/2018-07/CNIB%20Clear%20Print%20Guide.pdf
COP	CNIB Foundation. (2009-2019). <i>Clearing Our Path: Design Needs</i> . https://www.clearingourpath.ca/8.0.0-design-needs_e.php
CSA	Canadian Standards Association. (2023). <i>CSA Standards B651-23: Accessible Design for the Built Environment</i> . https://www.csagroup.org/wp-content/uploads/2430328.pdf
CSA	Accessibility Standards Canada. (2022). <i>CSA B651.2:22: Accessible Design for Self-Service Interactive Devices including Automated Banking Machines</i> .
CSP	California State Parks: Accessibility Section Acquisition and Development. (2015). <i>California State Parks Accessibility Guidelines</i> . https://www.parks.ca.gov/pages/21944/files/2015%20california%20state%20parks%20accessibility%20guidelines.pdf
CRFC	Canadian Recreation Facilities Council. (2007). <i>Sledge Hockey Accessibility: Design Guidelines for Arenas</i> . http://cdn.agilitycms.com/hockey-canada/Hockey-Programs/Sledge/Downloads/sledge_arena_guidelines_e.pdf
DGMA	Canadian Heritage Parks Canada. (1994). <i>Design Guidelines for Media Accessibility</i> . https://publications.gc.ca/collections/collection_2021/pc/R64-182-5-1993-eng.pdf
GAPSA	New Brunswick Human Rights Commission. (2017). <i>Guideline on Accommodating People with Service Animals</i> . https://www2.gnb.ca/content/dam/gnb/Departments/hrc-cdp/PDF/GuidelineonAccommodatingPeoplewithServiceAnimals-HRC-CDP201702.pdf

FOR OPERATIONAL GUIDANCE ONLY

Legend

ACRONYM	DOCUMENT OR WEBSITE
GCAF	Government of Canada. (2009). <i>Age-Friendly Rural and Remote Communities – Checklist of Age-Friendly Features</i> . https://www.canada.ca/en/public-health/services/health-promotion/aging-seniors/publications/publications-general-public/friendly-rural-remote-communities-a-guide/checklist-friendly-features.html
GEPP	Lubbock Fire Marshal's Office. (2009). <i>Guidelines for Emergency Planning and Preparedness</i> . https://ci.lubbock.tx.us/storage/images/qvW5NbJz2jnPHKOYEVOM72foUu7uL7xPfJ987LO9.pdf
HSE	Health and Safety Executive. (2006). <i>Welfare at Work- Guidance for employers on welfare provisions</i> . https://www.hse.gov.uk/pubns/indg293.pdf
MPADG	Mountains Recreation and Conservation Authority. (2006). <i>Malibu Parks Public Access Enhancement Plan: Park and Trail Accessibility Design Guidelines</i> . https://americantrails.s3.us-west-2.amazonaws.com/files/pdf/Trail-Accessibility-Design-Malibu.pdf
NB	Government of New Brunswick. (2021). <i>Barrier-Free Design Building Code NB Reg 2021-3</i> . https://laws.gnb.ca/en/showfulldoc/cr/2021-3/20220621
NBCAA	Government of New Brunswick. (2021). <i>New Brunswick Building Code Administration Act</i> . https://www2.gnb.ca/content/dam/gnb/Departments/ag-pg/PDF/RegulationsReglements/2021/2021-2.pdf
NBCC	National Research Council Canada and Canadian Commission on Building and Fire Codes. (2010). <i>National Building Code of Canada, Volume 1</i> . https://nrc-publications.canada.ca/eng/view/ft/?id=515340b5-f4e0-4798-be69-692e4ec423e8
NBNH	Government of New Brunswick. (2015). <i>Design Standards for Nursing Homes</i> . https://www2.gnb.ca/content/dam/gnb/Departments/sd-ds/pdf/NursingHomes/NursingHomeDesignStandards-e.pdf
NCSC	National Centre for State Courts. <i>Accessible Courtrooms (2023)</i> . https://www.ncsc.org/courthouseplanning/needs-of-persons-with-disabilities/accessiblecourtrooms#:~:text=A%20gooseneck%20microphone%20will%20suffice%20for%20this.%20Specific,cells%2C%20court-floor%20holding%20facilities%20and%20specific%20courtroom%20elements

FOR OPERATIONAL GUIDANCE ONLY

Legend

ACRONYM	DOCUMENT OR WEBSITE
OBC	Government of Ontario. (1992). <i>Ontario Regulation 368/13 Building Code Act</i> . https://www.ontario.ca/laws/regulation/r13368
OHS	Government of Canada. (2022). <i>Canada Occupational Health and Safety Regulations</i> . https://laws-lois.justice.gc.ca/eng/regulations/SOR-86-304/index.html
RHFSP	Rick Hansen Foundation School Program. (2020). <i>A Guide to Creating Accessible Play Spaces</i> . https://www.rickhansen.com/sites/default/files/2020-03/sch-35913-guide-creating-accessible-play-spacesen2020web.pdf
SC	Swimming Canada. (2018). <i>Facility Rules & Guidelines of Swimming Canada</i> . https://swimming.ca/content/uploads/2018/04/FACILITY- RULES_final_20180426.pdf
SFS	Sensory Friendly Solutions. (2022). https://www.sensoryfriendly.net/how-to-get-started-with-your-sensory-friendly-business/ https://www.sensoryfriendly.net/make-your-beach-sensory-friendly/
SPDOS	Saskatchewan Ministry of Health. (2012). <i>Swimming Pool Design and Operational Standards</i> . https://www.redcross.ca/crc/documents/Pool-Standards.pdf
TADG	City of Toronto. (2021). <i>Toronto Accessibility Design Guidelines</i> . https://www.toronto.ca/wp-content/uploads/2021/08/8ee5-Revised- TADG.pdf
TO	Chief Administrator's Office. (2003). <i>City of Toronto: Accessibility Design Guidelines</i> . https://www.toronto.ca/wp-content/uploads/2017/08/8fcf-accessibility_design_guidelines.pdf
UDG	Corporation of the District of Maple Ridge (BC) and the City of Pitt Meadows Municipal Advisory Committee on Accessibility Issues. (2010). <i>Universal Design Guidelines for Outdoor Spaces: Plan and Design for Choice</i> . https://www.researchgate.net/publication/280002247_Universal_Design_Guidelines_for_Outdoor_Spaces_Plan_and_Design_for_Choice
WHO	World Health Organization (2015). <i>Measuring the Age-Friendliness of Cities: A Guide to Using Core Indicators</i> . https://apps.who.int/iris/bitstream/handle/10665/203830/9789241509695_eng.pdf